

J.C. Broderick & Associates, Inc.

Environmental / Construction Consulting & Testing



February 2, 2021

Mr. Montgomery Granger
Wyandanch Union Free School District
Administration Building
1445 Dr. Martin Luther King Jr. Boulevard
Wyandanch, New York 11798

Re: **Lead Testing in School Drinking Water
2020 Compliance 10 NYCRR Subpart 67-4**

JCB#: **19-45375**

Dear Mr. Granger:

J.C. Broderick & Associates, Inc. (JCB) was retained to perform lead testing and analysis of the outlets which service the above referenced school district in accordance with 10 NYCRR Subpart 67-4 (Subpart 67-4).

The outlets servicing each of the school buildings were inventoried and assigned unique identification numbers. The use and location of each outlet was reviewed to determine its applicability for testing under Subpart 67-4.

An initial first-draw sample was collected from each applicable outlet after the minimum 8-hour stagnation period. Samples were logged into a chain of custody document, and delivered to an Environmental Laboratory Approval Program (ELAP) accredited laboratory for analysis.

Results from the laboratory analysis were compared with the Action Level as defined by Subpart 67-4 of 15 parts per billion (ppb). Any outlet which exceeded this level requires a remediation action plan be implemented (i.e. removal from service, placarding for non-drinking uses). Outlets which did not exceed the action level do not require further testing or remediation.

Please see the following attachments which detail the sampling and analysis performed and remediation actions taken to date.

Attachment 1: Lead Testing Results for Applicable Outlets

Attachment 2: Laboratory Analytical Reports

Attachment 3: Laboratory Certifications

If you have any questions, or if more information is needed, please contact our office.

Sincerely,

A handwritten signature in black ink, appearing to read 'Tara Ricker', is written over a light blue grid background.

Tara Ricker
J C Broderick & Associates, Inc.

Attachment 1:

Lead Testing Results
for Applicable Outlets



J.C. Broderick & Associates, Inc.


Environmental Consulting & Testing

1775 Expressway Drive North

Hauppauge, New York 11788

631.584.5492 fax 631.584.3395





Laboratory Lead in Water Results

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45375

Wyandanch Union Free School District

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
LaFrancis Hardiman Elementary School							
WYAN-0350	New Construction	Boy's Bathroom	Bathroom Faucet	Non-Potable	10/14/2020	OOS	Testing Required Before Return to Service
WYAN-0351	New Construction	Boy's Bathroom	Bathroom Faucet	Non-Potable	10/14/2020	3.9	Result Below Action Level, Continue O&M
WYAN-0352	New Construction	Boy's Bathroom	Bathroom Faucet	Non-Potable	10/14/2020	<3.0 ND	Result Below Action Level, Continue O&M
WYAN-0353	New Construction	Men's Bathroom	Bathroom Faucet	Non-Potable	10/14/2020	<3.0 ND	Result Below Action Level, Continue O&M
WYAN-0354	New Construction	Corridor To MLK (Outside Bathrooms By Main Lobby)	Bottle Fill Station	Potable	10/14/2020	<3.0 ND	Result Below Action Level, Continue O&M
WYAN-0355	New Construction	Corridor To MLK (Outside Bathrooms By Main Lobby)	Water Cooler	Potable	10/14/2020	OOS	Testing Required Before Return to Service
WYAN-0356	New Construction	Women's Bathroom	Bathroom Faucet	Non-Potable	10/14/2020	<3.0 ND	Result Below Action Level, Continue O&M
WYAN-0357	New Construction	Women's Bathroom	Bathroom Faucet	Non-Potable	12/9/2020	18	Placarded for Non-Drinking Use, Pending Remediation
WYAN-0358	New Construction	Girl's Bathroom	Bathroom Faucet	Non-Potable	10/14/2020	<3.0 ND	Result Below Action Level, Continue O&M
WYAN-0359	New Construction	Girl's Bathroom	Bathroom Faucet	Non-Potable	10/14/2020	1.7	Result Below Action Level, Continue O&M
WYAN-0360	New Construction	Girl's Bathroom	Bathroom Faucet	Non-Potable	10/14/2020	<3.0 ND	Result Below Action Level, Continue O&M
WYAN-0361	New Construction	Main Office Kitchen	Kitchen Faucet (Cold)	Potable	10/14/2020	1.5	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
WYAN-0362	New Construction	Main Office Kitchen	Spray Nozzle	Non-Potable	12/9/2020	5.6	Outlet Remediated and Returned to Service, Continue O&M
WYAN-0363	New Construction	Cafeteria Serving Area	Kitchen Faucet (Cold)	Non-Potable	10/14/2020	8.7	Result Below Action Level, Continue O&M
WYAN-0364	New Construction	Cafeteria Serving Area	Kitchen Faucet (Cold)	Potable	10/14/2020	4.0	Result Below Action Level, Continue O&M
WYAN-0365	New Construction	Cafeteria Serving Area	Spray Nozzle	Non-Potable	10/14/2020	5.3	Result Below Action Level, Continue O&M
WYAN-0366	New Construction	Kitchen	Kitchen Faucet (Cold)	Non-Potable	10/14/2020	OOS	Testing Required Before Return to Service
WYAN-0367	New Construction	Kitchen	Kitchen Faucet (Cold)	Potable	10/14/2020	2.5	Result Below Action Level, Continue O&M
WYAN-0368	New Construction	Kitchen	Kitchen Faucet (Cold)	Potable	10/14/2020	5.0	Result Below Action Level, Continue O&M
WYAN-0369	New Construction	Kitchen	Kitchen Faucet (Cold)	Potable	10/14/2020	1.1	Result Below Action Level, Continue O&M
WYAN-0370	New Construction	Kitchen	Spray Nozzle	Non-Potable	10/14/2020	1.1	Result Below Action Level, Continue O&M
WYAN-0371	New Construction	Kitchen	Spray Nozzle	Non-Potable	10/14/2020	3.8	Result Below Action Level, Continue O&M
WYAN-0372	New Construction	Kitchen	Kitchen Faucet (Cold)	Non-Potable	10/14/2020	1.7	Result Below Action Level, Continue O&M
WYAN-0373	New Construction	Kitchen	Pasta Pot/Steam Kettle	Potable	10/14/2020	2.8	Result Below Action Level, Continue O&M
WYAN-0374	New Construction	Kitchen	Kitchen Faucet (Cold)	Non-Potable	10/14/2020	5.2	Result Below Action Level, Continue O&M
WYAN-0375	New Construction	Kitchen	Kitchen Faucet (Cold)	Non-Potable	10/14/2020	1.1	Result Below Action Level, Continue O&M
WYAN-0376	New Construction	Kitchen Bathroom	Bathroom Faucet	Non-Potable	10/14/2020	3.4	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
WYAN-0378	New Construction	Kitchen Slop Sink Room	Spray Nozzle	Non-Potable	10/14/2020	OOS	Testing Required Before Return to Service
WYAN-0381	New Construction	Room 100	Classroom Faucet	Non-Potable	10/14/2020	1.9	Result Below Action Level, Continue O&M
WYAN-0382	New Construction	Room 101	Classroom Faucet	Non-Potable	10/14/2020	5.3	Result Below Action Level, Continue O&M
WYAN-0383	New Construction	Room 102	Classroom Faucet	Non-Potable	10/15/2020	2.1	Result Below Action Level, Continue O&M
WYAN-0384	New Construction	Room 103	Classroom Faucet	Non-Potable	10/14/2020	2.7	Result Below Action Level, Continue O&M
WYAN-0385	New Construction	Room 104	Classroom Faucet	Non-Potable	10/14/2020	3.4	Result Below Action Level, Continue O&M
WYAN-0386	New Construction	Room 105	Classroom Faucet	Non-Potable	10/14/2020	3.4	Result Below Action Level, Continue O&M
WYAN-0387	New Construction	Room 106	Classroom Faucet	Non-Potable	10/14/2020	<3.0 ND	Result Below Action Level, Continue O&M
WYAN-0388	New Construction	Room 107	Classroom Faucet	Non-Potable	10/14/2020	3.0	Result Below Action Level, Continue O&M
WYAN-0389	New Construction	Room 108	Classroom Faucet	Non-Potable	10/14/2020	8.8	Result Below Action Level, Continue O&M
WYAN-0390	New Construction	Room 109	Classroom Faucet	Non-Potable	10/14/2020	<3.0 ND	Result Below Action Level, Continue O&M
WYAN-0391	New Construction	Room 110	Classroom Faucet	Non-Potable	10/14/2020	3	Result Below Action Level, Continue O&M
WYAN-0392	New Construction	Room 111	Classroom Faucet	Non-Potable	10/14/2020	5.1	Result Below Action Level, Continue O&M
WYAN-0393	New Construction	Room 112	Classroom Faucet	Non-Potable	10/14/2020	2.4	Result Below Action Level, Continue O&M
WYAN-0394	New Construction	Room 113	Classroom Faucet	Non-Potable	10/14/2020	<3.0 ND	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
WYAN-0395	New Construction	Room 114	Classroom Faucet	Non-Potable	10/14/2020	2.6	Result Below Action Level, Continue O&M
WYAN-0396	New Construction	Room 116	Classroom Faucet	Non-Potable	10/14/2020	1.9	Result Below Action Level, Continue O&M
WYAN-0397	New Construction	Women's Bathroom	Bathroom Faucet	Non-Potable	10/14/2020	4.0	Result Below Action Level, Continue O&M
WYAN-0398	New Construction	Women's Bathroom	Bathroom Faucet	Non-Potable	10/14/2020	<3.0 ND	Result Below Action Level, Continue O&M
WYAN-0399	New Construction	Men's Bathroom	Bathroom Faucet	Non-Potable	10/14/2020	1.9	Result Below Action Level, Continue O&M
WYAN-0400	New Construction	Faculty Lounge	Kitchen Faucet (Cold)	Potable	10/14/2020	2.1	Result Below Action Level, Continue O&M
WYAN-0401	New Construction	Faculty Lounge	Spray Nozzle	Non-Potable	10/14/2020	OOS	Testing Required Before Return to Service
WYAN-0402	New Construction	Gym Locker Room Bathroom	Bathroom Faucet	Non-Potable	10/14/2020	1.9	Result Below Action Level, Continue O&M
WYAN-0403	New Construction	Gym Locker Room Bathroom	Bathroom Faucet	Non-Potable	12/9/2020	27	Placarded for Non-Drinking Use, Pending Remediation
WYAN-0404	New Construction	Gym Locker Room Bathroom	Bathroom Faucet	Non-Potable	10/14/2020	OOS	Testing Required Before Return to Service
WYAN-0405	New Construction	Gymnasium Lobby	Bottle Fill Station	Potable	10/14/2020	<3.0 ND	Result Below Action Level, Continue O&M
WYAN-0406	New Construction	Gymnasium Lobby	Water Cooler	Potable	10/14/2020	OOS	Testing Required Before Return to Service
WYAN-0407	New Construction	Gym Locker Room Bathroom	Bathroom Faucet	Non-Potable	10/14/2020	OOS	Testing Required Before Return to Service
WYAN-0408	New Construction	Gym Locker Room Bathroom	Bathroom Faucet	Non-Potable	10/14/2020	OOS	Testing Required Before Return to Service
WYAN-0409	New Construction	Gym Locker Room Bathroom	Bathroom Faucet	Non-Potable	10/14/2020	OOS	Testing Required Before Return to Service

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
WYAN-0411	New Construction	Room 117	Classroom Faucet	Non-Potable	10/14/2020	<3.0 ND	Result Below Action Level, Continue O&M
WYAN-0412	New Construction	Room 118	Classroom Faucet	Non-Potable	10/14/2020	<3.0 ND	Result Below Action Level, Continue O&M
WYAN-0413	New Construction	Room 119	Classroom Faucet	Non-Potable	10/14/2020	1.9	Result Below Action Level, Continue O&M
WYAN-0414	New Construction	Room 120	Classroom Faucet	Non-Potable	10/14/2020	2.4	Result Below Action Level, Continue O&M
WYAN-0415	New Construction	Room 121	Classroom Faucet	Non-Potable	10/14/2020	3.1	Result Below Action Level, Continue O&M
WYAN-0416	New Construction	Room 122	Classroom Faucet	Non-Potable	10/14/2020	2.9	Result Below Action Level, Continue O&M
WYAN-0417	New Construction	Room 123	Classroom Faucet	Non-Potable	10/14/2020	2.6	Result Below Action Level, Continue O&M
WYAN-0418	New Construction	Room 124	Classroom Faucet	Non-Potable	10/14/2020	4.2	Result Below Action Level, Continue O&M
WYAN-0448	New Construction	Cafeteria Serving Area Storage Room	Kitchen Faucet (Cold)	Non-Potable	12/9/2020	4200	Placarded for Non-Drinking Use, Pending Remediation
WYAN-0449	New Construction	Cafeteria Serving Area Storage Room	Ice Machine	Potable	10/15/2020	OOS	Testing Required Before Return to Service

Martin Luther King Elementary School

WYAN-0258	1054A	Room 17A	Classroom Faucet	Non-Potable	10/7/2020	5.9	Result Below Action Level, Continue O&M
WYAN-0259	1054A	Room 17A	Classroom Faucet	Non-Potable	10/7/2020	3.2	Result Below Action Level, Continue O&M
WYAN-0260	1052	Room 14	Classroom Faucet	Non-Potable	10/7/2020	5.9	Result Below Action Level, Continue O&M
WYAN-0261	1052	Room 14	Water Fountain-No Chiller	Potable	12/9/2020	15	Outlet Remediated and Returned to Service, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
WYAN-0262	1051	Room 15	Classroom Faucet	Non-Potable	10/7/2020	6.7	Result Below Action Level, Continue O&M
WYAN-0263	1051	Room 15	Water Fountain-No Chiller	Potable	10/7/2020	1.7	Result Below Action Level, Continue O&M
WYAN-0264	1050	Room 12	Classroom Faucet	Non-Potable	10/7/2020	3.4	Result Below Action Level, Continue O&M
WYAN-0265	1050	Room 12	Water Fountain-No Chiller	Potable	10/7/2020	<3.0 ND	Result Below Action Level, Continue O&M
WYAN-0266	1049	Room 13	Classroom Faucet	Non-Potable	10/7/2020	4.4	Result Below Action Level, Continue O&M
WYAN-0267	1049	Room 13	Water Fountain-No Chiller	Potable	10/7/2020	3.7	Result Below Action Level, Continue O&M
WYAN-0268	1048	Room 10	Classroom Faucet	Non-Potable	10/7/2020	3.4	Result Below Action Level, Continue O&M
WYAN-0269	1048	Room 10	Water Fountain-No Chiller	Potable	10/7/2020	<3.0 ND	Result Below Action Level, Continue O&M
WYAN-0270	1047	Room 11	Classroom Faucet	Non-Potable	10/7/2020	7.7	Result Below Action Level, Continue O&M
WYAN-0271	1047	Room 11	Water Fountain-No Chiller	Potable	10/7/2020	6.9	Result Below Action Level, Continue O&M
WYAN-0272	1046	Room 8	Classroom Faucet	Non-Potable	10/7/2020	6.9	Result Below Action Level, Continue O&M
WYAN-0273	1046	Room 8	Water Fountain-No Chiller	Potable	10/7/2020	OOS	Testing Required Before Return to Service
WYAN-0274	1043	Boys Bathroom	Bathroom Faucet	Non-Potable	10/7/2020	11	Result Below Action Level, Continue O&M
WYAN-0275	1043	Boys Bathroom	Bathroom Faucet	Non-Potable	10/7/2020	4.0	Result Below Action Level, Continue O&M
WYAN-0277	1040	Girls Bathroom	Bathroom Faucet	Non-Potable	10/7/2020	2.9	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
WYAN-0278	1040	Girls Bathroom	Bathroom Faucet	Non-Potable	10/7/2020	3.6	Result Below Action Level, Continue O&M
WYAN-0279	1040	Girls Bathroom	Bathroom Faucet	Non-Potable	10/7/2020	<3.0 ND	Result Below Action Level, Continue O&M
WYAN-0280	1036	Mens Faculty Restroom	Bathroom Faucet	Non-Potable	10/7/2020	7.9	Result Below Action Level, Continue O&M
WYAN-0281	1035	Women's Faculty Restroom	Bathroom Faucet	Non-Potable	10/7/2020	<3.0 ND	Result Below Action Level, Continue O&M
WYAN-0282	1038	Principals Office Vestibule	Classroom Faucet	Non-Potable	10/7/2020	4.3	Result Below Action Level, Continue O&M
WYAN-0283	1030	Kitchen	Kitchen Faucet (Cold)	Non-Potable	12/9/2020	29	Placarded for Non-Drinking Use, Pending Remediation
WYAN-0284	1030	Kitchen	Kitchen Faucet (Cold)	Non-Potable	10/7/2020	1.3	Result Below Action Level, Continue O&M
WYAN-0285	1030	Kitchen	Kitchen Faucet (Cold)	Non-Potable	10/7/2020	13	Result Below Action Level, Continue O&M
WYAN-0286	1030	Kitchen	Kitchen Faucet (Cold)	Potable	10/7/2020	2.4	Result Below Action Level, Continue O&M
WYAN-0287	1030	Kitchen	Kitchen Faucet (Cold)	Potable	10/7/2020	2.3	Result Below Action Level, Continue O&M
WYAN-0288	1030	Kitchen	Spray Nozzle	Non-Potable	10/7/2020	2.2	Result Below Action Level, Continue O&M
WYAN-0289	1030B1A	Kitchen Exit Vestibule Locker Room Bathroom	Bathroom Faucet	Non-Potable	10/7/2020	3.1	Result Below Action Level, Continue O&M
WYAN-0290	1029A2	Vestibule Security Office 18A Bathroom	Bathroom Faucet	Non-Potable	10/14/2020	5.3	Result Below Action Level, Continue O&M
WYAN-0291	1020A	Vestibule Storage	Water Fountain-No Chiller	Potable	10/14/2020	OOS	Testing Required Before Return to Service
WYAN-0292	1033	Main Lobby	Bottle Fill Station	Potable	10/14/2020	<3.0 ND	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
WYAN-0293	1033	Main Lobby	Water Cooler	Potable	10/14/2020	OOS	Testing Required Before Return to Service
WYAN-0295	1023A	Room 7A Bathroom	Bathroom Faucet	Non-Potable	10/14/2020	6.8	Result Below Action Level, Continue O&M
WYAN-0296	1017	Room 2	Classroom Faucet	Non-Potable	10/14/2020	<3.0 ND	Result Below Action Level, Continue O&M
WYAN-0297	1017B	Room 2 Bathroom	Bathroom Faucet	Non-Potable	12/9/2020	770	Placarded for Non-Drinking Use, Pending Remediation
WYAN-0298	1018	Room 3	Classroom Faucet	Non-Potable	10/14/2020	12	Result Below Action Level, Continue O&M
WYAN-0299	1018	Room 3	Water Fountain-No Chiller	Potable	12/9/2020	2.9	Outlet Remediated and Returned to Service, Continue O&M
WYAN-0300	1018A	Room 3 Bathroom	Bathroom Faucet	Non-Potable	10/14/2020	OOS	Testing Required Before Return to Service
WYAN-0301	1019	Room 1	Classroom Faucet	Non-Potable	10/14/2020	OOS	Testing Required Before Return to Service
WYAN-0302	1019	Room 1	Water Fountain-No Chiller	Potable	10/14/2020	OOS	Testing Required Before Return to Service
WYAN-0303	1019A	Room 1 Bathroom	Bathroom Faucet	Non-Potable	10/14/2020	OOS	Testing Required Before Return to Service
WYAN-0304	1016	Room 4	Classroom Faucet	Non-Potable	10/14/2020	OOS	Testing Required Before Return to Service
WYAN-0305	1016	Room 4	Water Fountain-No Chiller	Potable	10/14/2020	2.2	Result Below Action Level, Continue O&M
WYAN-0308	1013	Room 5	Classroom Faucet	Non-Potable	10/14/2020	2.7	Result Below Action Level, Continue O&M
WYAN-0309	1013	Room 5	Water Fountain-No Chiller	Potable	10/14/2020	OOS	Testing Required Before Return to Service
WYAN-0310	1012	Room 6	Classroom Faucet	Non-Potable	10/14/2020	5.5	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
WYAN-0311	1012	Room 6	Water Fountain-No Chiller	Potable	10/14/2020	13	Result Below Action Level, Continue O&M
WYAN-0317	2016A1	Suite 30 Women's Bathroom	Bathroom Faucet	Non-Potable	10/14/2020	<3.0 ND	Result Below Action Level, Continue O&M
WYAN-0318	2016C1	Suite 30 Men's Bathroom	Bathroom Faucet	Non-Potable	10/14/2020	2.1	Result Below Action Level, Continue O&M
WYAN-0319	2016B6	Suite 30 Classroom Lounge	Kitchen Faucet (Cold)	Potable	10/14/2020	9.3	Result Below Action Level, Continue O&M
WYAN-0320	2016B6	Suite 30 Classroom Lounge	Spray Nozzle	Non-Potable	10/14/2020	<3.0 ND	Result Below Action Level, Continue O&M
WYAN-0321	2015	Girls Bathroom	Bathroom Faucet	Non-Potable	10/14/2020	OOS	Testing Required Before Return to Service
WYAN-0322	2015	Girls Bathroom	Bathroom Faucet	Non-Potable	10/14/2020	<3.0 ND	Result Below Action Level, Continue O&M
WYAN-0323	2015	Girls Bathroom	Bathroom Faucet	Non-Potable	10/14/2020	<3.0 ND	Result Below Action Level, Continue O&M
WYAN-0325	2013	Boys Bathroom	Bathroom Faucet	Non-Potable	10/14/2020	1.6	Result Below Action Level, Continue O&M
WYAN-0326	2013	Boys Bathroom	Bathroom Faucet	Non-Potable	10/14/2020	3.6	Result Below Action Level, Continue O&M
WYAN-0327	2011	Room 21	Classroom Faucet	Non-Potable	10/14/2020	3.6	Result Below Action Level, Continue O&M
WYAN-0328	2011	Room 21	Water Fountain-No Chiller	Potable	10/14/2020	2.4	Result Below Action Level, Continue O&M
WYAN-0329	2010	Room 20	Classroom Faucet	Non-Potable	10/14/2020	13	Result Below Action Level, Continue O&M
WYAN-0330	2010	Room 20	Water Fountain-No Chiller	Potable	10/14/2020	OOS	Testing Required Before Return to Service
WYAN-0331	2009	Room 22	Classroom Faucet	Non-Potable	12/9/2020	2.0	Outlet Remediated and Returned to Service, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
WYAN-0332	2009	Room 22	Water Fountain-No Chiller	Potable	10/14/2020	OOS	Testing Required Before Return to Service
WYAN-0333	2008	Room 23	Classroom Faucet	Non-Potable	10/14/2020	1.5	Result Below Action Level, Continue O&M
WYAN-0334	2008	Room 23	Water Fountain-No Chiller	Potable	12/9/2020	9.9	Outlet Remediated and Returned to Service, Continue O&M
WYAN-0335	2007	Room 24	Classroom Faucet	Non-Potable	10/14/2020	1	Result Below Action Level, Continue O&M
WYAN-0336	2007	Room 24	Water Fountain-No Chiller	Potable	10/14/2020	OOS	Testing Required Before Return to Service
WYAN-0337	2006	Room 25	Classroom Faucet	Non-Potable	10/14/2020	3.7	Result Below Action Level, Continue O&M
WYAN-0338	2006	Room 25	Water Fountain-No Chiller	Potable	10/14/2020	OOS	Testing Required Before Return to Service
WYAN-0339	2005	Room 26	Classroom Faucet	Non-Potable	10/14/2020	2.7	Result Below Action Level, Continue O&M
WYAN-0340	2005	Room 26	Water Fountain-No Chiller	Potable	10/14/2020	1.2	Result Below Action Level, Continue O&M
WYAN-0341	2004	Room 27	Classroom Faucet	Non-Potable	12/9/2020	32	Placarded for Non-Drinking Use, Pending Remediation
WYAN-0342	2004	Room 27	Water Fountain-No Chiller	Potable	10/14/2020	OOS	Testing Required Before Return to Service
WYAN-0343	2003	Room 29	Classroom Faucet	Non-Potable	10/14/2020	2.4	Result Below Action Level, Continue O&M
WYAN-0344	2003	Room 29	Water Fountain-No Chiller	Potable	10/14/2020	12	Result Below Action Level, Continue O&M
WYAN-0345	2002	Room 28	Classroom Faucet	Non-Potable	10/14/2020	6.8	Result Below Action Level, Continue O&M
WYAN-0346	2002	Room 28	Water Fountain-No Chiller	Potable	10/14/2020	OOS	Testing Required Before Return to Service

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
---------------	----------	------------------	-------------	----------------------	-------------	--------------	------------------------------------

Milton L. Olive Middle School

WYAN-0147	1031B	Cafeteria Kitchen	Kitchen Faucet (Cold)	Potable	10/9/2020	3.9	Result Below Action Level, Continue O&M
WYAN-0148	1031B	Cafeteria Kitchen	Kitchen Faucet (Cold)	Potable	10/9/2020	2.9	Result Below Action Level, Continue O&M
WYAN-0149	1031B	Cafeteria Kitchen	Ice Machine	Potable	10/9/2020	<3.0 ND	Result Below Action Level, Continue O&M
WYAN-0150	1031B	Cafeteria Kitchen	Kitchen Faucet (Cold)	Potable	10/9/2020	8.7	Result Below Action Level, Continue O&M
WYAN-0151	1031B	Cafeteria Kitchen	Kitchen Faucet (Cold)	Non-Potable	10/9/2020	2.4	Result Below Action Level, Continue O&M
WYAN-0152	1031B	Cafeteria Kitchen	Kitchen Faucet (Cold)	Non-Potable	10/9/2020	9.2	Result Below Action Level, Continue O&M
WYAN-0153	1031B	Cafeteria Kitchen	Spray Nozzle	Non-Potable	10/9/2020	9.0	Result Below Action Level, Continue O&M
WYAN-0154	1031B2B	Cafeteria Kitchen Exit Vestibule Can Wash	Bathroom Faucet	Non-Potable	12/9/2020	1.7	Outlet Remediated and Returned to Service, Continue O&M
WYAN-0155	1038	Corridor Gym to Main Lobby (By Stage - 1033A)	Bottle Fill Station	Potable	10/9/2020	<3.0 ND	Result Below Action Level, Continue O&M
WYAN-0156	1038	Corridor Gym to Main Lobby (By Stage - 1033A)	Water Cooler	Potable	10/9/2020	OOS	Testing Required Before Return to Service
WYAN-0158	1034A	Nurse's Office Bathroom	Bathroom Faucet	Non-Potable	10/9/2020	5.2	Result Below Action Level, Continue O&M
WYAN-0163	1067	Corridor Server Closet to Room 16 (Outside Girls' Bathroom - 1056)	Bottle Fill Station	Potable	10/9/2020	<3.0 ND	Result Below Action Level, Continue O&M
WYAN-0164	1067	Corridor Server Closet to Room 16 (Outside Girls' Bathroom - 1056)	Water Cooler	Potable	10/9/2020	OOS	Testing Required Before Return to Service
WYAN-0168	New Construction	Portable Classroom P2	Water Cooler	Potable	10/9/2020	1.2	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
WYAN-0170	New Construction	Custodial Closet	Bathroom Faucet	Non-Potable	10/9/2020	2	Result Below Action Level, Continue O&M
WYAN-0171	New Construction	Classroom P4	Water Cooler	Potable	10/9/2020	<3.0 ND	Result Below Action Level, Continue O&M
WYAN-0172	New Construction	Classroom P4 Bathroom	Bathroom Faucet	Non-Potable	10/9/2020	<3.0 ND	Result Below Action Level, Continue O&M
WYAN-0173	New Construction	Classroom P6	Water Cooler	Potable	10/9/2020	OOS	Testing Required Before Return to Service
WYAN-0174	New Construction	Classroom P6 Bathroom	Bathroom Faucet	Non-Potable	10/9/2020	<3.0 ND	Result Below Action Level, Continue O&M
WYAN-0175	New Construction	Classroom P5	Water Cooler	Potable	10/9/2020	OOS	Testing Required Before Return to Service
WYAN-0176	New Construction	Classroom P5 Bathroom	Bathroom Faucet	Non-Potable	12/9/2020	1.8	Outlet Remediated and Returned to Service, Continue O&M
WYAN-0177	New Construction	Classroom P3	Water Cooler	Potable	10/9/2020	<3.0 ND	Result Below Action Level, Continue O&M
WYAN-0178	New Construction	Classroom P3 Bathroom	Bathroom Faucet	Non-Potable	10/9/2020	3.6	Result Below Action Level, Continue O&M
WYAN-0179	New Construction	Classroom P1	Water Cooler	Potable	10/9/2020	1.7	Result Below Action Level, Continue O&M
WYAN-0180	New Construction	Classroom P1 Bathroom	Bathroom Faucet	Non-Potable	10/9/2020	1.6	Result Below Action Level, Continue O&M
WYAN-0188	1040	Room 1 Shop	Classroom Faucet	Non-Potable	10/9/2020	OOS	Testing Required Before Return to Service
WYAN-0189	1040B	Room 1 Shop Bathroom	Bathroom Faucet	Non-Potable	12/9/2020	31000	Placarded for Non-Drinking Use, Pending Remediation
WYAN-0190	1033D1A	Gym Vestibule PE Office Bathroom	Bathroom Faucet	Non-Potable	12/9/2020	140	Placarded for Non-Drinking Use, Pending Remediation
WYAN-0191	1033C	Gym Girl's Locker Room	Water Fountain-No Chiller	Potable	10/9/2020	4.2	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
WYAN-0192	1033B2A	Gym Vestibule Boy's Locker Room Bathroom	Bathroom Faucet	Non-Potable	10/9/2020	OOS	Testing Required Before Return to Service
WYAN-0193	1033B1	Gym Vestibule Boy's PE Office	Bottled Water Dispenser	Potable	10/9/2020	<3.0 ND	Result Below Action Level, Continue O&M
WYAN-0194	1033B1	Gym Vestibule Boy's PE Office	Bottled Water Dispenser	Potable	10/9/2020	<3.0 ND	Result Below Action Level, Continue O&M
WYAN-0195	1033B1A	Gym Vestibule Boy's PE Office Bathroom	Bathroom Faucet	Non-Potable	12/9/2020	4.8	Outlet Remediated and Returned to Service, Continue O&M
WYAN-0211	1019	Room 18	Classroom Faucet	Non-Potable	10/9/2020	1.5	Result Below Action Level, Continue O&M
WYAN-0212	1019	Room 18	Classroom Faucet	Non-Potable	10/9/2020	3	Result Below Action Level, Continue O&M
WYAN-0213	1017	Home Economics Room 20	Home Economics Faucet (Cold)	Potable	12/9/2020	13	Outlet Remediated and Returned to Service, Continue O&M
WYAN-0214	1017	Home Economics Room 20	Home Economics Faucet (Cold)	Potable	10/9/2020	3.8	Result Below Action Level, Continue O&M
WYAN-0215	1017	Home Economics Room 20	Bottle Fill Station	Potable	10/9/2020	OOS	Testing Required Before Return to Service
WYAN-0216	1017	Home Economics Room 20	Ice Machine	Potable	10/9/2020	OOS	Testing Required Before Return to Service
WYAN-0231	1030	Corridor Attendance to Stairwell (Outside Room 22 - 1013)	Bottle Fill Station	Potable	10/9/2020	<3.0 ND	Result Below Action Level, Continue O&M
WYAN-0232	1030	Corridor Attendance to Stairwell (Outside Room 22 - 1013)	Water Cooler	Potable	10/9/2020	OOS	Testing Required Before Return to Service
WYAN-0233	2018	2nd Floor Corridor (Outside Room 40 - 2004)	Bottle Fill Station	Potable	10/9/2020	1.2	Result Below Action Level, Continue O&M
WYAN-0234	2018	2nd Floor Corridor (Outside Room 40 - 2004)	Water Cooler	Potable	10/9/2020	OOS	Testing Required Before Return to Service
WYAN-0244	2017A	Staff Lounge Corridor Women's Faculty Bathroom	Bathroom Faucet	Non-Potable	10/9/2020	15	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
WYAN-0245	2017B	Staff Lounge Corridor Men's Faculty Bathroom	Bathroom Faucet	Non-Potable	10/9/2020	13	Result Below Action Level, Continue O&M
WYAN-0450	1033C2	Gym Girl's Locker Room Bathroom	Bathroom Faucet	Non-Potable	12/9/2020	34	Placarded for Non-Drinking Use, Pending Remediation

Wyandanch Bus Garage

WYAN-0252	1007	Main Garage (By Dispatch Office - 1001)	Water Cooler	Potable	10/7/2020	<3.0 ND	Result Below Action Level, Continue O&M
WYAN-0254	1002	Restroom	Bathroom Faucet	Non-Potable	10/7/2020	3.5	Result Below Action Level, Continue O&M

Wyandanch Central Administration

WYAN-0419	1019	Men's Bathroom	Bathroom Faucet	Non-Potable	10/7/2020	5.8	Result Below Action Level, Continue O&M
WYAN-0420	1019	Men's Bathroom	Bathroom Faucet	Non-Potable	10/7/2020	7.2	Result Below Action Level, Continue O&M
WYAN-0421	1018	Women's Bathroom	Bathroom Faucet	Non-Potable	10/7/2020	5.5	Result Below Action Level, Continue O&M
WYAN-0422	1018	Women's Bathroom	Bathroom Faucet	Non-Potable	10/7/2020	2.6	Result Below Action Level, Continue O&M
WYAN-0423	1017	Corridor to Elementary Schools (Outside Board Room - 1009)	Water Cooler	Potable	10/7/2020	OOS	Testing Required Before Return to Service
WYAN-0429	1015	Main Corridor & Lobby (Outside Men's Restroom - 1011)	Water Cooler	Potable	10/7/2020	7.4	Result Below Action Level, Continue O&M
WYAN-0430	1009B	Administration Kitchen	Kitchen Faucet (Cold)	Potable	10/7/2020	14	Result Below Action Level, Continue O&M
WYAN-0431	1015	Main Corridor & Lobby (Outside Superintendents Office - 1002)	Water Cooler	Potable	10/7/2020	6.7	Result Below Action Level, Continue O&M
WYAN-0435	1006B1	Office Kitchen	Kitchen Faucet (Cold)	Potable	12/9/2020	12	Outlet Remediated and Returned to Service, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
WYAN-0436	1006B1	Office Kitchen	Spray Nozzle	Non-Potable	10/7/2020	6.5	Result Below Action Level, Continue O&M

Wyandanch Memorial High School

WYAN-0001	1020A1	Boys Locker Room Vestibule Bathroom	Bathroom Faucet	Non-Potable	10/8/2020	2.8	Result Below Action Level, Continue O&M
WYAN-0002	1020D	Boys Locker Room Coach's Office	Bottled Water Dispenser	Potable	10/8/2020	<3.0 ND	Result Below Action Level, Continue O&M
WYAN-0003	1020D1	Boys' Locker Room Coach's Office Bathroom	Bathroom Faucet	Non-Potable	12/9/2020	20	Placarded for Non-Drinking Use, Pending Remediation
WYAN-0007	1024	Corridor Auditorium Stage To Girls Bathroom (Outside Boys' Locker Room - 1020)	Bottle Fill Station	Potable	10/8/2020	<3.0 ND	Result Below Action Level, Continue O&M
WYAN-0008	1024	Corridor Auditorium Stage To Girls Bathroom (Outside Boys' Locker Room - 1020)	Water Cooler	Potable	10/8/2020	OOS	Testing Required Before Return to Service
WYAN-0011	1025A1	Girls' Locker Room Coach's Office Bathroom	Bathroom Faucet	Non-Potable	12/9/2020	52	Placarded for Non-Drinking Use, Pending Remediation
WYAN-0012	1032	Girls Locker Room	Bottle Fill Station	Potable	10/8/2020	<3.0 ND	Result Below Action Level, Continue O&M
WYAN-0013	1032	Girls Locker Room	Water Cooler	Potable	10/8/2020	10	Result Below Action Level, Continue O&M
WYAN-0014	1032A1	Girls Locker Room Exit Vestibule Bathroom	Bathroom Faucet	Non-Potable	10/8/2020	5.8	Result Below Action Level, Continue O&M
WYAN-0015	1028	Kitchen	Kitchen Faucet (Cold)	Non-Potable	10/8/2020	9.6	Result Below Action Level, Continue O&M
WYAN-0016	1028	Kitchen	Kitchen Faucet (Cold)	Potable	10/8/2020	1.2	Result Below Action Level, Continue O&M
WYAN-0017	1028	Kitchen	Kitchen Faucet (Cold)	Potable	10/8/2020	3.4	Result Below Action Level, Continue O&M
WYAN-0018	1028	Kitchen	Spray Nozzle	Non-Potable	10/8/2020	3.0	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
WYAN-0019	1028	Kitchen	Kitchen Faucet (Cold)	Non-Potable	10/8/2020	6.0	Result Below Action Level, Continue O&M
WYAN-0020	1028	Kitchen	Ice Machine	Potable	10/8/2020	<3.0 ND	Result Below Action Level, Continue O&M
WYAN-0021	1028	Kitchen	Kitchen Faucet (Cold)	Potable	10/8/2020	4.0	Result Below Action Level, Continue O&M
WYAN-0022	1028	Kitchen	Kitchen Faucet (Cold)	Potable	10/8/2020	3.1	Result Below Action Level, Continue O&M
WYAN-0023	1028	Kitchen	Spray Nozzle	Non-Potable	10/8/2020	13	Result Below Action Level, Continue O&M
WYAN-0024	1028D	Kitchen Dietician Office	Bathroom Faucet	Non-Potable	10/8/2020	9.1	Result Below Action Level, Continue O&M
WYAN-0034	1033A	Food Service Suite Bathroom	Bathroom Faucet	Non-Potable	10/8/2020	<3.0 ND	Result Below Action Level, Continue O&M
WYAN-0035	1034	Nurse's Vestibule	Nurse's Office Sink	Potable	10/8/2020	2.3	Result Below Action Level, Continue O&M
WYAN-0036	1035	Security Vestibule	Bathroom Faucet	Non-Potable	10/8/2020	<3.0 ND	Result Below Action Level, Continue O&M
WYAN-0037	1036A	Athletic Vestibule Bathroom	Classroom Faucet	Non-Potable	10/8/2020	9.4	Result Below Action Level, Continue O&M
WYAN-0038	1037B	Custodial Office Bathroom	Bathroom Faucet	Non-Potable	10/8/2020	2.7	Result Below Action Level, Continue O&M
WYAN-0039	1056F	Main Office Bathroom	Bathroom Faucet	Non-Potable	10/8/2020	<3.0 ND	Result Below Action Level, Continue O&M
WYAN-0040	1060	Main Lobby	Bottle Fill Station	Potable	10/8/2020	<3.0 ND	Result Below Action Level, Continue O&M
WYAN-0041	1060	Main Lobby	Water Cooler	Potable	10/8/2020	OOS	Testing Required Before Return to Service
WYAN-0042	1054A	Central Registration/Attendance Office	Kitchen Faucet (Cold)	Potable	12/9/2020	220	Removed From Service, Pending Remediation

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
WYAN-0052	1055	Corridor Central Registration to Room 119 (By Elevator)	Bottle Fill Station	Potable	10/8/2020	<3.0 ND	Result Below Action Level, Continue O&M
WYAN-0053	1055	Corridor Central Registration to Room 119 (By Elevator)	Water Cooler	Potable	10/8/2020	OOS	Testing Required Before Return to Service
WYAN-0063	1067	Home Economics Room 105	Home Economics Faucet (Cold)	Potable	10/8/2020	<3.0 ND	Result Below Action Level, Continue O&M
WYAN-0064	1067	Room 105	Spray Nozzle	Non-Potable	10/8/2020	3.1	Result Below Action Level, Continue O&M
WYAN-0065	1067B	Home Economics Room 105 Office	Home Economics Faucet (Cold)	Potable	10/8/2020	2.2	Result Below Action Level, Continue O&M
WYAN-0066	1067B	Home Economics Room 105 Office	Spray Nozzle	Non-Potable	10/8/2020	3.5	Result Below Action Level, Continue O&M
WYAN-0069	1069	Faculty Room 103	Kitchen Faucet (Cold)	Potable	12/9/2020	140	Removed From Service, Pending Remediation
WYAN-0070	1069	Faculty Room 103	Spray Nozzle	Non-Potable	12/9/2020	75	Placarded for Non-Drinking Use, Pending Remediation
WYAN-0071	1075	Corridor Guidance to Main Lobby (Outside Faculty Room 103 - 1069)	Bottle Fill Station	Potable	10/8/2020	<3.0 ND	Result Below Action Level, Continue O&M
WYAN-0072	1075	Corridor Guidance to Main Lobby (Outside Faculty Room 103 - 1069)	Water Cooler	Potable	10/8/2020	OOS	Testing Required Before Return to Service
WYAN-0073	2027	Corridor Science Lab 200 To Room 219 (By Science Lab 201 - 2024)	Bottle Fill Station	Potable	10/8/2020	<3.0 ND	Result Below Action Level, Continue O&M
WYAN-0074	2027	Corridor Science Lab 200 To Room 219 (By Science Lab 201 - 2024)	Water Cooler	Potable	10/8/2020	OOS	Testing Required Before Return to Service
WYAN-0101	2027	Corridor Science Lab 200 To Room 219 (Outside Athletic Director's Suite 223 - 2013)	Bottle Fill Station	Potable	10/8/2020	<3.0 ND	Result Below Action Level, Continue O&M
WYAN-0102	2027	Corridor Science Lab 200 To Room 219 (Outside Athletic Director's Suite 223 - 2013)	Water Cooler	Potable	10/8/2020	OOS	Testing Required Before Return to Service
WYAN-0126	2009	Art Room 213	Classroom Faucet	Non-Potable	10/8/2020	2.4	Result Below Action Level, Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
WYAN-0136	2027	Corridor Science Lab 200 To Room 219 (By Elevator)	Bottle Fill Station	Potable	10/8/2020	<3.0 ND	Result Below Action Level, Continue O&M
WYAN-0137	2027	Corridor Science Lab 200 To Room 219 (By Elevator)	Water Cooler	Potable	10/15/2020	OOS	Testing Required Before Return to Service

Attachment 2:

Chain of Custody
&
Laboratory Analysis


J.C. Broderick & Associates, Inc.

Environmental Consulting & Testing

1775 Expressway Drive North

Hauppauge, New York 11788

631.584.5492 fax 631.584.3395

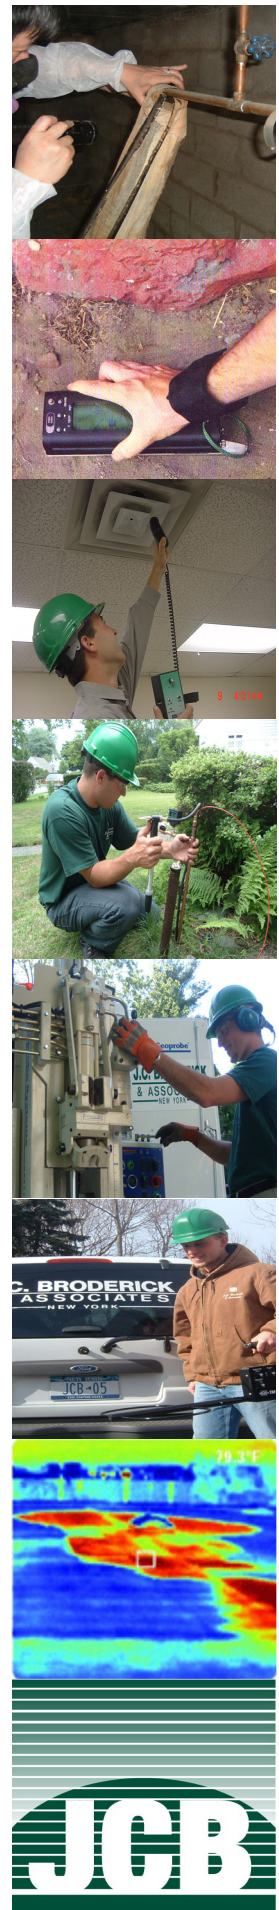



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45375

Building: Martin Luther King Elementary School

MLKES

062019401

Client:

Wyandanch Union Free School District

Retest/New Install []

Turn Around: Normal 1 wk Rush _____

Page 1 of 7

Sample ID	Functional Space Type	AMERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
WYAN-0258	CR	1054A	Room 17A	CF	10/7/2020	6:48:00 AM
WYAN-0259	CR	1054A	Room 17A	CF	10/7/2020	6:48:00 AM
WYAN-0260	CR	1052	Room 14	CF	10/7/2020	6:50:00 AM
WYAN-0261	CR	1052	Room 14	DW	10/7/2020	6:50:00 AM
WYAN-0262	CR	1051	Room 15	CF	10/7/2020	6:52:00 AM
WYAN-0263	CR	1051	Room 15	DW	10/7/2020	6:52:00 AM
WYAN-0264	CR	1050	Room 12	CF	10/7/2020	6:54:00 AM
WYAN-0265	CR	1050	Room 12	DW	10/7/2020	6:54:00 AM
WYAN-0266	CR	1049	Room 13	CF	10/7/2020	6:57:00 AM
WYAN-0267	CR	1049	Room 13	DW	10/7/2020	6:57:00 AM
WYAN-0268	CR	1048	Room 10	CF	10/7/2020	7:00:00 AM
WYAN-0269	CR	1048	Room 10	DW	10/7/2020	7:00:00 AM
WYAN-0270	CR	1047	Room 11	CF	10/7/2020	7:02:00 AM
WYAN-0271	CR	1047	Room 11	DW	10/7/2020	7:02:00 AM
WYAN-0272	CR	1046	Room 8	CF	10/7/2020	7:04:00 AM
WYAN-0274	BR	1043	Boys Bathroom	BF	10/7/2020	7:06:00 AM
WYAN-0275	BR	1043	Boys Bathroom	BF	10/7/2020	7:06:00 AM
WYAN-0277	BR	1040	Girls Bathroom	BF	10/7/2020	7:08:00 AM

Building Address

792 Mount Avenue

Wyandanch, NY 11798

Pb200.5 -
A. Jung 10/29/20

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Samplers Name: Zachary Strehel

Samplers Signature: Zachary Strehel

JCB Project Manager: Tara Ricker

RECEIVED
JCB ANALYTICAL, INC.
CARLE PLACE, NY
11798
10/29/20
PM 12:24

OrderID: 062019401



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45375

Building: Martin Luther King Elementary School

MLKES

062019401

Client:

Wyandanch Union Free School District

Retest/New Install []

Turn Around: Normal 1 wk Rush

Page 2 of 7

OrderID: 062019401

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
WYAN-0278	BR	1040	Girls Bathroom	BF	10/7/2020	7:08:00 AM
WYAN-0279	BR	1040	Girls Bathroom	BF	10/7/2020	7:08:00 AM
WYAN-0280	BR	1036	Mens Faculty Restroom	BF	10/7/2020	7:10:00 AM
WYAN-0281	BR	1035	Women's Faculty Restroom	BF	10/7/2020	7:11:00 AM
WYAN-0282	OF	1038	Principals Office Vestibule	CF	10/7/2020	7:14:00 AM
WYAN-0283	KI	1030	Kitchen	KC	10/7/2020	7:16:00 AM
WYAN-0284	KI	1030	Kitchen	KC	10/7/2020	7:19:00 AM
WYAN-0285	KI	1030	Kitchen	KC	10/7/2020	7:21:00 AM
WYAN-0286	KI	1030	Kitchen	KC	10/7/2020	7:21:00 AM
WYAN-0287	KI	1030	Kitchen	KC	10/7/2020	7:23:00 AM
WYAN-0288	KI	1030	Kitchen	SN	10/7/2020	7:26:00 AM
WYAN-0289	BR	1030B2A		BF	10/7/2020	7:28:00 AM
WYAN-0290	BR	1029A2	Vestibule Security Office 18A Bathroom	BF	10/14/2020	5:18:00 AM
WYAN-0292	HA	1033	Main Lobby	WF	10/14/2020	5:21:00 AM
WYAN-0295	BR	1023A	Room 7A Bathroom	BF	10/14/2020	5:23:00 AM
WYAN-0296	CR	1017	Room 2	CF	10/14/2020	2:25:00 AM
WYAN-0297	BR	1017B	Room 2 Bathroom	BF	10/14/2020	5:27:00 AM
WYAN-0298	CR	1018	Room 3	CF	10/14/2020	5:29:00 AM

Building Address

792 Mount Avenue

Wyandanch, NY 11798

Pb 200.5

A. Lamy 10/29/20

Analysis Type: ELAP 200.5

Lab Received:

Signature:

faele

Samplers Name: *Zachary Steele*

Samplers Signature: *Zachary Steele*

JCB Project Manager: *Tara Ricker*

2020 OCT 29 PM 12:24
CARL E. PIATKE, INC.
NEW YORK, NY



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45375

Building: Martin Luther King Elementary School

MLKES

062 019401

Client:

Wyandanch Union Free School District

Retest/New Install ☐

Turn Around: Normal 1 wk Rush ☐

Page 3 of 7

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
WYAN-0299	CR	1018	Room 3	DW	10/14/2020	5:30:00 AM
WYAN-0305	CR	1016	Room 4	DW	10/14/2020	5:34:00 AM
WYAN-0308	CR	1013	Room 5	CF	10/14/2020	5:36:00 AM
WYAN-0310	CR	1012	Room 6	CF	10/14/2020	5:37:00 AM
WYAN-0311	CR	1012	Room 6	DW	10/14/2020	5:38:00 AM
WYAN-0317	BR	2016A1	Suite 30 Women's Bathroom	BF	10/14/2020	5:47:00 AM
WYAN-0318	BR	2016C1	Suite 30 Men's Bathroom	BF	10/14/2020	5:48:00 AM
WYAN-0319	FL	2016B6	Suite 30 Classroom Lounge	KC	10/14/2020	7:38:00 AM
WYAN-0320	FL	2016B6	Suite 30 Classroom Lounge	SN	10/14/2020	5:50:00 AM
WYAN-0322	BR	2015	Girls Bathroom	BF	10/14/2020	5:51:00 AM
WYAN-0323	BR	2015	Girls Bathroom	BF	10/14/2020	5:52:00 AM
WYAN-0325	BR	2013	Boys Bathroom	BF	10/14/2020	5:53:00 AM
WYAN-0326	BR	2013	Boys Bathroom	BF	10/14/2020	5:54:00 AM
WYAN-0327	CR	2011	Room 21	CF	10/14/2020	5:55:00 AM
WYAN-0328	CR	2011	Room 21	DW	10/14/2020	5:56:00 AM
WYAN-0329	CR	2010	Room 20	CF	10/14/2020	5:57:00 AM
WYAN-0331	CR	2009	Room 22	CF	10/14/2020	5:58:00 AM
WYAN-0333	CR	2008	Room 23	CF	10/14/2020	5:59:00 AM

Building Address

792 Mount Avenue

Wyandanch, NY 11798

Analysis Type: ELAP 200.5

Lab Received: Chels

Signature: [Signature]

Samplers Name: Jose Roldan

Samplers Signature: [Signature]

JCB Project Manager: Tara Ricker

RECEIVED
JCB ANALYTICAL, INC.
CARLE PLACE, NY
10515
10 OCT 5 PM 12:24

OrderID: 062019401



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45375

Building: Martin Luther King Elementary School

MLKES

062019401

Client:

Wyandanch Union Free School District

Retest/New Install []

Turn Around: Normal 1 wk Rush

Page 4 of 7

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
WYAN-0334	CR	2008	Room 23	DW	10/14/2020	6:00:00 AM
WYAN-0335	CR	2007	Room 24	CF	10/14/2020	7:40:00 AM
WYAN-0337	CR	2006	Room 25	CF	10/14/2020	6:01:00 AM
WYAN-0339	CR	2005	Room 26	CF	10/14/2020	6:02:00 AM
WYAN-0340	CR	2005	Room 26	DW	10/14/2020	6:03:00 AM
WYAN-0341	CR	2004	Room 27	CF	10/14/2020	6:04:00 AM
WYAN-0343	CR	2003	Room 29	CF	10/14/2020	6:05:00 AM
WYAN-0344	CR	2003	Room 29	DW	10/14/2020	6:06:00 AM
WYAN-0345	CR	2002	Room 28	CF	10/14/2020	6:07:00 AM
WYAN-0351	BR	N/A	Boy's Bathroom	BF	10/14/2020	6:19:00 AM
WYAN-0352	BR	N/A	Boy's Bathroom	BF	10/14/2020	6:20:00 AM
WYAN-0353	BR	N/A	Men's Bathroom	BF	10/14/2020	6:21:00 AM
WYAN-0354	HA	N/A	Corridor To MLK (Outside Bathrooms By Main Lobby)	WF	10/14/2020	6:22:00 AM
WYAN-0356	BR	N/A	Women's Bathroom	BF	10/14/2020	6:23:00 AM
WYAN-0357	BR	N/A	Women's Bathroom	BF	10/14/2020	6:24:00 AM
WYAN-0358	BR	N/A	Girl's Bathroom	BF	10/14/2020	6:25:00 AM
WYAN-0359	BR	N/A	Girl's Bathroom	BF	10/14/2020	6:25:00 AM
WYAN-0360	BR	N/A	Girl's Bathroom	BF	10/14/2020	6:26:00 AM

Building Address

792 Mount Avenue

Wyandanch, NY 11798

Pb 200.5

A. L... 10/29/20

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Samplers Name: Jose Roldan

Samplers Signature:

JCB Project Manager: Jara Rickes

10/29/20
10:21:24
JCB PROJECT, INC.
CORNELIUS PLACE, NY

OrderID: 062019401



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45375
Building: Martin Luther King Elementary School
MLKES

062 019401

Page 5 of 7

Client: Wyandanch Union Free School District
Retest/New Install ☐
Turn Around: Normal 1 wk Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
WYAN-0361	OF/KI	N/A	Main Office Kitchen	KC	10/14/2020	6:27:00 AM
WYAN-0362	OF/KI	N/A	Main Office Kitchen	SN	10/14/2020	6:28:00 AM
WYAN-0363	KI/CA	N/A	Cafeteria Serving Area	KC	10/14/2020	6:29:00 AM
WYAN-0364	KI/CA	N/A	Cafeteria Serving Area	KC	10/14/2020	6:30:00 AM
WYAN-0365	KI/CA	N/A	Cafeteria Serving Area	SN	10/14/2020	6:31:00 AM
WYAN-0367	KI	N/A	Kitchen	KC	10/14/2020	6:32:00 AM
WYAN-0368	KI	N/A	Kitchen	KC	10/14/2020	6:33:00 AM
WYAN-0369	KI	N/A	Kitchen	KC	10/14/2020	6:34:00 AM
WYAN-0370	KI	N/A	Kitchen	SN	10/14/2020	6:35:00 AM
WYAN-0371	KI	N/A	Kitchen	SN	10/14/2020	6:36:00 AM
WYAN-0372	KI	N/A	Kitchen	KC	10/14/2020	6:37:00 AM
WYAN-0373	KI	N/A	Kitchen	PK	10/14/2020	6:38:00 AM
WYAN-0374	KI	N/A	Kitchen	KC	10/14/2020	6:39:00 AM
WYAN-0375	KI	N/A	Kitchen	KC	10/14/2020	6:40:00 AM
WYAN-0376	BR	N/A	Kitchen Bathroom	BF	10/14/2020	6:41:00 AM
WYAN-0381	CR	N/A	Room 100	CF	10/14/2020	6:43:00 AM
WYAN-0382	CR	N/A	Room 101	CF	10/14/2020	6:44:00 AM
WYAN-0383	CR	N/A	Room 102	CF	10/15/2020	6:06:00 AM

Building Address Pb200.5 -
792 Mount Avenue
Wyandanch, NY 11798

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Samplers Name: Jose Boldon

Samplers Signature: [Signature]

JCB Project Manager: Tara Pickett

STANDARD
SAMPLE PLACEMENT
10/29/20
11:12:24
JCB PROJECT
MANAGER
TARA PICKETT
JCB PROJECT
MANAGER
TARA PICKETT

OrderID: 062019401



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45375

Building: Martin Luther King Elementary School

MLKES

062019401

Client:

Wyandanch Union Free School District

Retest/New Install []

Turn Around: Normal 1 wk Rush

Page 6 of 7

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
WYAN-0384	CR	N/A	Room 103	CF	10/14/2020	6:46:00 AM
WYAN-0385	CR	N/A	Room 104	CF	10/14/2020	6:47:00 AM
WYAN-0386	CR	N/A	Room 105	CF	10/14/2020	6:48:00 AM
WYAN-0387	CR	N/A	Room 106	CF	10/14/2020	6:49:00 AM
WYAN-0388	CR	N/A	Room 107	CF	10/14/2020	6:50:00 AM
WYAN-0389	CR	N/A	Room 108	CF	10/14/2020	6:51:00 AM
WYAN-0390	CR	N/A	Room 109	CF	10/14/2020	6:52:00 AM
WYAN-0391	CR	N/A	Room 110	CF	10/14/2020	6:53:00 AM
WYAN-0392	CR	N/A	Room 111	CF	10/14/2020	6:54:00 AM
WYAN-0393	CR	N/A	Room 112	CF	10/14/2020	6:55:00 AM
WYAN-0394	CR	N/A	Room 113	CF	10/14/2020	6:56:00 AM
WYAN-0395	CR	N/A	Room 114	CF	10/14/2020	6:57:00 AM
WYAN-0396	CR	N/A	Room 116	CF	10/14/2020	6:58:00 AM
WYAN-0397	BR	N/A	Women's Bathroom	BF	10/14/2020	6:59:00 AM
WYAN-0398	BR	N/A	Women's Bathroom	BF	10/14/2020	7:00:00 AM
WYAN-0399	BR	N/A	Men's Bathroom	BF	10/14/2020	7:01:00 AM
WYAN-0400	FL	N/A	Faculty Lounge	KC	10/14/2020	7:07:00 AM
WYAN-0402	BR	N/A	Gym Locker Room Bathroom	BF	10/14/2020	7:04:00 AM

Building Address

792 Mount Avenue

Wyandanch, NY 11798

Ph 206.5-

A. Lamy 10/29/20

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Samplers Name: Jose Roldon

Samplers Signature:

JCB Project Manager: Tara Pickler

ST. MICHAEL'S
LABORATORY, INC.
1000
EAST 100TH
ST. LITTLE ROCK, AR 72616-1000
FAX: 501-261-1112

OrderID: 062019401



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45375

Building: Martin Luther King Elementary School

MLKES

062019401

Client:

Wyandanch Union Free School District

Retest/New Install | |

Turn Around: Normal 1 wk Rush _____

Page 7 of 7

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
WYAN-0403	BR	N/A	Gym Locker Room Bathroom	BF	10/14/2020	7:05:00 AM
WYAN-0405	HA	N/A	Gymnasium Lobby	WF	10/14/2020	7:07:00 AM
WYAN-0411	CR	N/A	Room 117	CF	10/14/2020	7:11:00 AM
WYAN-0412	CR	N/A	Room 118	CF	10/14/2020	7:12:00 AM
WYAN-0413	CR	N/A	Room 119	CF	10/14/2020	7:13:00 AM
WYAN-0414	CR	N/A	Room 120	CF	10/14/2020	7:14:00 AM
WYAN-0415	CR	N/A	Room 121	CF	10/14/2020	7:15:00 AM
WYAN-0416	CR	N/A	Room 122	CF	10/14/2020	7:16:00 AM
WYAN-0417	CR	N/A	Room 123	CF	10/14/2020	7:17:00 AM
WYAN-0418	CR	N/A	Room 124	CF	10/14/2020	7:18:00 AM
WYAN-0448	ST	New Construction	Cafeteria Serving Area Storage Room	KC	10/14/2020	7:42:00 AM

Samples Submitted 119

RECEIVED
CISL ANALYTICAL, INC.
CARLE PLACE, NY
20 OCT 15 PM 12:24

Building Address

792 Mount Avenue

Wyandanch, NY 11798

By 200.5 -
A. Perry 10/29/20

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Samplers Name: Jose Roldan

Samplers Signature:

JCB Project Manager: Tara Ricker



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Tara Ricker
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

11/30/2020

Phone: (631) 584-5492

Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 10/15/2020. The results are tabulated on the attached data pages for the following client designated project:

#19-45375, Martin Luther King Elementary School, Wyandanch
Union Free School District, 792 Mount Avenue, Wyandanch NY
11798

The reference number for these samples is EMSL Order #062019401. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Alger Liang, Lead Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062019401

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Tara Ricker**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 10/15/2020 12:24 PM
 Collected: 10/7/2020

Project: #19-45375, Martin Luther King Elementary School, Wyandanch Union Free School District, 792 Mount Avenue, Wyandanch NY 11798

Analytical Results

Client Sample Description		WYAN-0258	Collected:	10/7/2020	Lab ID:	062019401-0001		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.9	3.0	µg/L	10/27/2020	DI	10/29/2020	AL
Client Sample Description		WYAN-0259	Collected:	10/7/2020	Lab ID:	062019401-0002		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.2	3.0	µg/L	10/27/2020	DI	10/29/2020	AL
Client Sample Description		WYAN-0260	Collected:	10/7/2020	Lab ID:	062019401-0003		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.9	3.0	µg/L	10/27/2020	DI	10/29/2020	AL
Client Sample Description		WYAN-0261	Collected:	10/7/2020	Lab ID:	062019401-0004		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	16	3.0	µg/L	10/27/2020	DI	10/29/2020	AL
Client Sample Description		WYAN-0262	Collected:	10/7/2020	Lab ID:	062019401-0005		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.7	3.0	µg/L	10/27/2020	DI	10/29/2020	AL
Client Sample Description		WYAN-0263	Collected:	10/7/2020	Lab ID:	062019401-0006		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.7 J	3.0	µg/L	10/27/2020	DI	10/29/2020	AL
		Lead MDL: 1.0µg/L						
Client Sample Description		WYAN-0264	Collected:	10/7/2020	Lab ID:	062019401-0007		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.4	3.0	µg/L	10/27/2020	DI	10/29/2020	AL
Client Sample Description		WYAN-0265	Collected:	10/7/2020	Lab ID:	062019401-0008		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062019401

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Tara Ricker**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 10/15/2020 12:24 PM
 Collected: 10/7/2020

Project: #19-45375, Martin Luther King Elementary School, Wyandanch Union Free School District, 792 Mount Avenue, Wyandanch NY 11798

Analytical Results

Client Sample Description WYAN-0265 **Collected:** 10/7/2020 **Lab ID:** 062019401-0008

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	10/27/2020	DI	10/29/2020	AL

Client Sample Description WYAN-0266 **Collected:** 10/7/2020 **Lab ID:** 062019401-0009

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.4	3.0 µg/L	10/27/2020	DI	10/29/2020	AL

Client Sample Description WYAN-0267 **Collected:** 10/7/2020 **Lab ID:** 062019401-0010

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.7	3.0 µg/L	10/27/2020	DI	10/29/2020	AL

Client Sample Description WYAN-0268 **Collected:** 10/7/2020 **Lab ID:** 062019401-0011

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.4	3.0 µg/L	10/27/2020	DI	10/29/2020	AL

Client Sample Description WYAN-0269 **Collected:** 10/7/2020 **Lab ID:** 062019401-0012

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	10/27/2020	DI	10/29/2020	AL

Client Sample Description WYAN-0270 **Collected:** 10/7/2020 **Lab ID:** 062019401-0013

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	7.7	3.0 µg/L	10/27/2020	DI	10/29/2020	AL

Client Sample Description WYAN-0271 **Collected:** 10/7/2020 **Lab ID:** 062019401-0014

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.9	3.0 µg/L	10/27/2020	DI	10/29/2020	AL

Client Sample Description WYAN-0272 **Collected:** 10/7/2020 **Lab ID:** 062019401-0015

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062019401

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Tara Ricker**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 10/15/2020 12:24 PM
 Collected: 10/7/2020

Project: #19-45375, Martin Luther King Elementary School, Wyandanch Union Free School District, 792 Mount Avenue, Wyandanch NY 11798

Analytical Results

Client Sample Description		WYAN-0272	Collected:	10/7/2020	Lab ID:	062019401-0015		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.9	3.0	µg/L	10/27/2020	DI	10/29/2020	AL
Client Sample Description		WYAN-0274	Collected:	10/7/2020	Lab ID:	062019401-0016		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	11	3.0	µg/L	10/27/2020	DI	10/29/2020	AL
Client Sample Description		WYAN-0275	Collected:	10/7/2020	Lab ID:	062019401-0017		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.0	3.0	µg/L	10/27/2020	DI	10/29/2020	AL
Client Sample Description		WYAN-0277	Collected:	10/7/2020	Lab ID:	062019401-0018		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.9 J	3.0	µg/L	10/27/2020	DI	10/29/2020	AL
		Lead MDL: 1.0µg/L						
Client Sample Description		WYAN-0278	Collected:	10/7/2020	Lab ID:	062019401-0019		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.6	3.0	µg/L	10/27/2020	DI	10/29/2020	AL
Client Sample Description		WYAN-0279	Collected:	10/7/2020	Lab ID:	062019401-0020		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	10/27/2020	DI	10/29/2020	AL
Client Sample Description		WYAN-0280	Collected:	10/7/2020	Lab ID:	062019401-0021		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	7.9	3.0	µg/L	10/27/2020	DI	10/29/2020	AL
Client Sample Description		WYAN-0281	Collected:	10/7/2020	Lab ID:	062019401-0022		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062019401

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Tara Ricker**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 10/15/2020 12:24 PM
 Collected: 10/7/2020

Project: #19-45375, Martin Luther King Elementary School, Wyandanch Union Free School District, 792 Mount Avenue, Wyandanch NY 11798

Analytical Results

Client Sample Description WYAN-0281 **Collected:** 10/7/2020 **Lab ID:** 062019401-0022

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	10/27/2020	DI	10/29/2020	AL

Client Sample Description WYAN-0282 **Collected:** 10/7/2020 **Lab ID:** 062019401-0023

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.3	3.0 µg/L	10/27/2020	DI	10/29/2020	AL

Client Sample Description WYAN-0283 **Collected:** 10/7/2020 **Lab ID:** 062019401-0024

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	190	3.0 µg/L	10/27/2020	DI	10/29/2020	AL

Client Sample Description WYAN-0284 **Collected:** 10/7/2020 **Lab ID:** 062019401-0025

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.3 J	3.0 µg/L	10/27/2020	DI	10/29/2020	AL

Lead MDL: 1.0µg/L

Client Sample Description WYAN-0285 **Collected:** 10/7/2020 **Lab ID:** 062019401-0026

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	13	3.0 µg/L	10/27/2020	DI	10/29/2020	AL

Client Sample Description WYAN-0286 **Collected:** 10/7/2020 **Lab ID:** 062019401-0027

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.4 J	3.0 µg/L	10/27/2020	DI	10/29/2020	AL

Lead MDL: 1.0µg/L

Client Sample Description WYAN-0287 **Collected:** 10/7/2020 **Lab ID:** 062019401-0028

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.3 J	3.0 µg/L	10/27/2020	DI	10/29/2020	AL

Lead MDL: 1.0µg/L

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062019401

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Tara Ricker**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 10/15/2020 12:24 PM
 Collected: 10/7/2020

Project: #19-45375, Martin Luther King Elementary School, Wyandanch Union Free School District, 792 Mount Avenue, Wyandanch NY 11798

Analytical Results

Client Sample Description		WYAN-0288	Collected:	10/7/2020	Lab ID:	062019401-0029		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.2 J	3.0	µg/L	10/27/2020	DI	10/29/2020	AL
Lead MDL: 1.0µg/L								
Client Sample Description		WYAN-0289	Collected:	10/7/2020	Lab ID:	062019401-0030		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.1	3.0	µg/L	10/27/2020	DI	10/29/2020	AL
Client Sample Description		WYAN-0290	Collected:	10/7/2020	Lab ID:	062019401-0031		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.3	3.0	µg/L	10/27/2020	DI	10/29/2020	AL
Client Sample Description		WYAN-0292	Collected:	10/7/2020	Lab ID:	062019401-0032		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	10/27/2020	DI	10/29/2020	AL
Client Sample Description		WYAN-0295	Collected:	10/7/2020	Lab ID:	062019401-0033		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.8	3.0	µg/L	10/27/2020	DI	10/29/2020	AL
Client Sample Description		WYAN-0296	Collected:	10/7/2020	Lab ID:	062019401-0034		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	10/27/2020	DI	10/29/2020	AL
Client Sample Description		WYAN-0297	Collected:	10/7/2020	Lab ID:	062019401-0035		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	280	6.0	µg/L	10/27/2020	DI	10/29/2020	AL
Client Sample Description		WYAN-0298	Collected:	10/7/2020	Lab ID:	062019401-0036		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062019401

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Tara Ricker**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 10/15/2020 12:24 PM
 Collected: 10/7/2020

Project: #19-45375, Martin Luther King Elementary School, Wyandanch Union Free School District, 792 Mount Avenue, Wyandanch NY 11798

Analytical Results

Client Sample Description		WYAN-0298	Collected:	10/7/2020	Lab ID:	062019401-0036		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	12	3.0	µg/L	10/27/2020	DI	10/29/2020	AL
Client Sample Description		WYAN-0299	Collected:	10/7/2020	Lab ID:	062019401-0037		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	160	3.0	µg/L	10/27/2020	DI	10/29/2020	AL
Client Sample Description		WYAN-0305	Collected:	10/7/2020	Lab ID:	062019401-0038		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.2 J	3.0	µg/L	10/27/2020	DI	10/29/2020	AL
		Lead MDL: 1.0µg/L						
Client Sample Description		WYAN-0308	Collected:	10/7/2020	Lab ID:	062019401-0039		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.7 J	3.0	µg/L	10/27/2020	DI	10/29/2020	AL
		Lead MDL: 1.0µg/L						
Client Sample Description		WYAN-0310	Collected:	10/7/2020	Lab ID:	062019401-0040		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.5	3.0	µg/L	10/27/2020	DI	10/29/2020	AL
Client Sample Description		WYAN-0311	Collected:	10/7/2020	Lab ID:	062019401-0041		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	13	3.0	µg/L	10/27/2020	DI	10/29/2020	AL
Client Sample Description		WYAN-0317	Collected:	10/7/2020	Lab ID:	062019401-0042		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	10/27/2020	DI	10/29/2020	AL

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062019401

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Tara Ricker**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 10/15/2020 12:24 PM
 Collected: 10/7/2020

Project: #19-45375, Martin Luther King Elementary School, Wyandanch Union Free School District, 792 Mount Avenue, Wyandanch NY 11798

Analytical Results

Client Sample Description		WYAN-0318	Collected:	10/7/2020	Lab ID:	062019401-0043		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.1 J	3.0	µg/L	10/27/2020	DI	10/29/2020	AL
Lead MDL: 1.0µg/L								
Client Sample Description		WYAN-0319	Collected:	10/7/2020	Lab ID:	062019401-0044		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	9.3	3.0	µg/L	10/27/2020	DI	10/29/2020	AL
Client Sample Description		WYAN-0320	Collected:	10/7/2020	Lab ID:	062019401-0045		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	10/27/2020	DI	10/29/2020	AL
Client Sample Description		WYAN-0322	Collected:	10/7/2020	Lab ID:	062019401-0046		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	10/27/2020	DI	10/29/2020	AL
Client Sample Description		WYAN-0323	Collected:	10/7/2020	Lab ID:	062019401-0047		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	10/27/2020	DI	10/29/2020	AL
Client Sample Description		WYAN-0325	Collected:	10/7/2020	Lab ID:	062019401-0048		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.6 J	3.0	µg/L	10/27/2020	DI	10/29/2020	AL
Lead MDL: 1.0µg/L								
Client Sample Description		WYAN-0326	Collected:	10/7/2020	Lab ID:	062019401-0049		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.6	3.0	µg/L	10/27/2020	DI	10/29/2020	AL

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062019401

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Tara Ricker**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 10/15/2020 12:24 PM
 Collected: 10/7/2020

Project: #19-45375, Martin Luther King Elementary School, Wyandanch Union Free School District, 792 Mount Avenue, Wyandanch NY 11798

Analytical Results

Client Sample Description WYAN-0327 **Collected:** 10/7/2020 **Lab ID:** 062019401-0050

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.6	3.0 µg/L	10/27/2020	DI	10/29/2020	AL

Client Sample Description WYAN-0328 **Collected:** 10/7/2020 **Lab ID:** 062019401-0051

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.4 J	3.0 µg/L	10/27/2020	DI	10/29/2020	AL

Lead MDL: 1.0µg/L

Client Sample Description WYAN-0329 **Collected:** 10/7/2020 **Lab ID:** 062019401-0052

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	13	3.0 µg/L	10/27/2020	DI	10/29/2020	AL

Client Sample Description WYAN-0331 **Collected:** 10/7/2020 **Lab ID:** 062019401-0053

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	31	3.0 µg/L	10/27/2020	DI	10/29/2020	AL

Client Sample Description WYAN-0333 **Collected:** 10/7/2020 **Lab ID:** 062019401-0054

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.5 J	3.0 µg/L	10/27/2020	DI	10/29/2020	AL

Lead MDL: 1.0µg/L

Client Sample Description WYAN-0334 **Collected:** 10/7/2020 **Lab ID:** 062019401-0055

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	21	3.0 µg/L	10/27/2020	DI	10/29/2020	AL

Client Sample Description WYAN-0335 **Collected:** 10/7/2020 **Lab ID:** 062019401-0056

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.0 J	3.0 µg/L	10/27/2020	DI	10/29/2020	AL

Lead MDL: 1.0µg/L

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062019401

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Tara Ricker**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 10/15/2020 12:24 PM
 Collected: 10/7/2020

Project: #19-45375, Martin Luther King Elementary School, Wyandanch Union Free School District, 792 Mount Avenue, Wyandanch NY 11798

Analytical Results

Client Sample Description WYAN-0337 **Collected:** 10/7/2020 **Lab ID:** 062019401-0057

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.7	3.0 µg/L	10/27/2020	DI	10/29/2020	AL

Client Sample Description WYAN-0339 **Collected:** 10/7/2020 **Lab ID:** 062019401-0058

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.7 J	3.0 µg/L	10/27/2020	DI	10/29/2020	AL
Lead MDL: 1.0µg/L							

Client Sample Description WYAN-0340 **Collected:** 10/7/2020 **Lab ID:** 062019401-0059

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.2 J	3.0 µg/L	10/27/2020	DI	10/29/2020	AL
Lead MDL: 1.0µg/L							

Client Sample Description WYAN-0341 **Collected:** 10/7/2020 **Lab ID:** 062019401-0060

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	27	3.0 µg/L	10/27/2020	DI	10/29/2020	AL

Client Sample Description WYAN-0343 **Collected:** 10/7/2020 **Lab ID:** 062019401-0061

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.4 J	3.0 µg/L	10/27/2020	DI	10/29/2020	AL
Lead MDL: 1.0µg/L							

Client Sample Description WYAN-0344 **Collected:** 10/7/2020 **Lab ID:** 062019401-0062

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	12	3.0 µg/L	10/27/2020	DI	10/29/2020	AL

Client Sample Description WYAN-0345 **Collected:** 10/7/2020 **Lab ID:** 062019401-0063

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.8	3.0 µg/L	10/27/2020	DI	10/29/2020	AL

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062019401

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Tara Ricker**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 10/15/2020 12:24 PM
 Collected: 10/7/2020

Project: #19-45375, Martin Luther King Elementary School, Wyandanch Union Free School District, 792 Mount Avenue, Wyandanch NY 11798

Analytical Results

Client Sample Description WYAN-0351 **Collected:** 10/7/2020 **Lab ID:** 062019401-0064

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.9	3.0 µg/L	10/27/2020	DI	10/29/2020	AL

Client Sample Description WYAN-0352 **Collected:** 10/7/2020 **Lab ID:** 062019401-0065

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	10/27/2020	DI	10/29/2020	AL

Client Sample Description WYAN-0353 **Collected:** 10/7/2020 **Lab ID:** 062019401-0066

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	10/27/2020	DI	10/29/2020	AL

Client Sample Description WYAN-0354 **Collected:** 10/7/2020 **Lab ID:** 062019401-0067

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	10/27/2020	DI	10/29/2020	AL

Client Sample Description WYAN-0356 **Collected:** 10/7/2020 **Lab ID:** 062019401-0068

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	10/27/2020	DI	10/29/2020	AL

Client Sample Description WYAN-0357 **Collected:** 10/7/2020 **Lab ID:** 062019401-0069

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	23	3.0 µg/L	10/27/2020	DI	10/29/2020	AL

Client Sample Description WYAN-0358 **Collected:** 10/7/2020 **Lab ID:** 062019401-0070

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	10/27/2020	DI	10/29/2020	AL

Client Sample Description WYAN-0359 **Collected:** 10/7/2020 **Lab ID:** 062019401-0071

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062019401

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Tara Ricker**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 10/15/2020 12:24 PM
 Collected: 10/7/2020

Project: #19-45375, Martin Luther King Elementary School, Wyandanch Union Free School District, 792 Mount Avenue, Wyandanch NY 11798

Analytical Results

Client Sample Description		WYAN-0359	Collected:	10/7/2020	Lab ID:	062019401-0071		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.7 J	3.0	µg/L	10/27/2020	DI	10/29/2020	AL
Lead MDL: 1.0µg/L								
Client Sample Description		WYAN-0360	Collected:	10/7/2020	Lab ID:	062019401-0072		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	10/27/2020	DI	10/29/2020	AL
Client Sample Description		WYAN-0361	Collected:	10/7/2020	Lab ID:	062019401-0073		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.5 J	3.0	µg/L	10/27/2020	DI	10/29/2020	AL
Lead MDL: 1.0µg/L								
Client Sample Description		WYAN-0362	Collected:	10/7/2020	Lab ID:	062019401-0074		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	50	3.0	µg/L	10/27/2020	DI	10/29/2020	AL
Client Sample Description		WYAN-0363	Collected:	10/7/2020	Lab ID:	062019401-0075		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	8.7	3.0	µg/L	10/27/2020	DI	10/29/2020	AL
Client Sample Description		WYAN-0364	Collected:	10/7/2020	Lab ID:	062019401-0076		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.0	3.0	µg/L	10/27/2020	DI	10/29/2020	AL
Client Sample Description		WYAN-0365	Collected:	10/7/2020	Lab ID:	062019401-0077		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.3	3.0	µg/L	10/27/2020	DI	10/29/2020	AL

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062019401

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Tara Ricker**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 10/15/2020 12:24 PM
 Collected: 10/7/2020

Project: #19-45375, Martin Luther King Elementary School, Wyandanch Union Free School District, 792 Mount Avenue, Wyandanch NY 11798

Analytical Results

Client Sample Description WYAN-0367 **Collected:** 10/7/2020 **Lab ID:** 062019401-0078

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.5 J	3.0 µg/L	10/27/2020	DI	10/29/2020	AL
Lead MDL: 1.0µg/L							

Client Sample Description WYAN-0368 **Collected:** 10/7/2020 **Lab ID:** 062019401-0079

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.0	3.0 µg/L	10/27/2020	DI	10/29/2020	AL

Client Sample Description WYAN-0369 **Collected:** 10/7/2020 **Lab ID:** 062019401-0080

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.1 J	3.0 µg/L	10/27/2020	DI	10/29/2020	AL
Lead MDL: 1.0µg/L							

Client Sample Description WYAN-0370 **Collected:** 10/7/2020 **Lab ID:** 062019401-0081

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.1 J	3.0 µg/L	10/27/2020	DI	10/29/2020	AL
Lead MDL: 1.0µg/L							

Client Sample Description WYAN-0371 **Collected:** 10/7/2020 **Lab ID:** 062019401-0082

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.8	3.0 µg/L	10/27/2020	DI	10/29/2020	AL

Client Sample Description WYAN-0372 **Collected:** 10/7/2020 **Lab ID:** 062019401-0083

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.7 J	3.0 µg/L	10/27/2020	DI	10/29/2020	AL
Lead MDL: 1.0µg/L							

Client Sample Description WYAN-0373 **Collected:** 10/7/2020 **Lab ID:** 062019401-0084

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.8 J	3.0 µg/L	10/27/2020	DI	10/29/2020	AL
Lead MDL: 1.0µg/L							

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062019401

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Tara Ricker**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 10/15/2020 12:24 PM
 Collected: 10/7/2020

Project: #19-45375, Martin Luther King Elementary School, Wyandanch Union Free School District, 792 Mount Avenue, Wyandanch NY 11798

Analytical Results

Client Sample Description WYAN-0374 **Collected:** 10/7/2020 **Lab ID:** 062019401-0085

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.2	3.0 µg/L	10/27/2020	DI	10/29/2020	AL

Client Sample Description WYAN-0375 **Collected:** 10/7/2020 **Lab ID:** 062019401-0086

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.1 J	3.0 µg/L	10/27/2020	DI	10/29/2020	AL
Lead MDL: 1.0µg/L							

Client Sample Description WYAN-0376 **Collected:** 10/7/2020 **Lab ID:** 062019401-0087

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.4	3.0 µg/L	10/27/2020	DI	10/29/2020	AL

Client Sample Description WYAN-0381 **Collected:** 10/7/2020 **Lab ID:** 062019401-0088

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.9 J	3.0 µg/L	10/27/2020	DI	10/29/2020	AL
Lead MDL: 1.0µg/L							

Client Sample Description WYAN-0382 **Collected:** 10/7/2020 **Lab ID:** 062019401-0089

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.3	3.0 µg/L	10/27/2020	DI	10/29/2020	AL

Client Sample Description WYAN-0383 **Collected:** 10/7/2020 **Lab ID:** 062019401-0090

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.1 J	3.0 µg/L	10/27/2020	DI	10/29/2020	AL
Lead MDL: 1.0µg/L							

Client Sample Description WYAN-0384 **Collected:** 10/7/2020 **Lab ID:** 062019401-0091

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.7 J	3.0 µg/L	10/27/2020	DI	10/29/2020	AL
Lead MDL: 1.0µg/L							

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062019401

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Tara Ricker**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 10/15/2020 12:24 PM
 Collected: 10/7/2020

Project: #19-45375, Martin Luther King Elementary School, Wyandanch Union Free School District, 792 Mount Avenue, Wyandanch NY 11798

Analytical Results

Client Sample Description		WYAN-0385	Collected:	10/7/2020	Lab ID:	062019401-0092		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.4	3.0	µg/L	10/27/2020	DI	10/29/2020	AL
Client Sample Description		WYAN-0386	Collected:	10/7/2020	Lab ID:	062019401-0093		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.4	3.0	µg/L	10/27/2020	DI	10/29/2020	AL
Client Sample Description		WYAN-0387	Collected:	10/7/2020	Lab ID:	062019401-0094		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	10/27/2020	DI	10/29/2020	AL
Client Sample Description		WYAN-0388	Collected:	10/7/2020	Lab ID:	062019401-0095		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.0	3.0	µg/L	10/27/2020	DI	10/29/2020	AL
Client Sample Description		WYAN-0389	Collected:	10/7/2020	Lab ID:	062019401-0096		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	8.8	3.0	µg/L	10/27/2020	DI	10/29/2020	AL
Client Sample Description		WYAN-0390	Collected:	10/7/2020	Lab ID:	062019401-0097		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	10/27/2020	DI	10/29/2020	AL
Client Sample Description		WYAN-0391	Collected:	10/7/2020	Lab ID:	062019401-0098		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 J	3.0	µg/L	10/27/2020	DI	10/29/2020	AL
Client Sample Description		WYAN-0392	Collected:	10/7/2020	Lab ID:	062019401-0099		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062019401

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Tara Ricker**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 10/15/2020 12:24 PM
 Collected: 10/7/2020

Project: #19-45375, Martin Luther King Elementary School, Wyandanch Union Free School District, 792 Mount Avenue, Wyandanch NY 11798

Analytical Results

Client Sample Description		WYAN-0392	Collected:	10/7/2020	Lab ID:	062019401-0099		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.1	3.0	µg/L	10/27/2020	DI	10/29/2020	AL
Client Sample Description		WYAN-0393	Collected:	10/7/2020	Lab ID:	062019401-0100		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.4 J	3.0	µg/L	10/27/2020	DI	10/29/2020	AL
Lead MDL: 1.0µg/L								
Client Sample Description		WYAN-0394	Collected:	10/7/2020	Lab ID:	062019401-0101		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	10/27/2020	DI	10/29/2020	AL
Client Sample Description		WYAN-0395	Collected:	10/7/2020	Lab ID:	062019401-0102		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.6 J	3.0	µg/L	10/27/2020	DI	10/29/2020	AL
Lead MDL: 1.0µg/L								
Client Sample Description		WYAN-0396	Collected:	10/7/2020	Lab ID:	062019401-0103		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.9 J	3.0	µg/L	10/27/2020	DI	10/29/2020	AL
Lead MDL: 1.0µg/L								
Client Sample Description		WYAN-0397	Collected:	10/7/2020	Lab ID:	062019401-0104		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.0	3.0	µg/L	10/27/2020	DI	10/29/2020	AL
Client Sample Description		WYAN-0398	Collected:	10/7/2020	Lab ID:	062019401-0105		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	10/27/2020	DI	10/29/2020	AL

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062019401

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Tara Ricker**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 10/15/2020 12:24 PM
 Collected: 10/7/2020

Project: #19-45375, Martin Luther King Elementary School, Wyandanch Union Free School District, 792 Mount Avenue, Wyandanch NY 11798

Analytical Results

Client Sample Description WYAN-0399 **Collected:** 10/7/2020 **Lab ID:** 062019401-0106

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.9 J	3.0 µg/L	10/27/2020	DI	10/29/2020	AL
Lead MDL: 1.0µg/L							

Client Sample Description WYAN-0400 **Collected:** 10/7/2020 **Lab ID:** 062019401-0107

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.1 J	3.0 µg/L	10/27/2020	DI	10/29/2020	AL
Lead MDL: 1.0µg/L							

Client Sample Description WYAN-0402 **Collected:** 10/7/2020 **Lab ID:** 062019401-0108

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.9 J	3.0 µg/L	10/27/2020	DI	10/29/2020	AL
Lead MDL: 1.0µg/L							

Client Sample Description WYAN-0403 **Collected:** 10/7/2020 **Lab ID:** 062019401-0109

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	290	6.0 µg/L	10/27/2020	DI	10/29/2020	AL

Client Sample Description WYAN-0405 **Collected:** 10/7/2020 **Lab ID:** 062019401-0110

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	10/27/2020	DI	10/29/2020	AL

Client Sample Description WYAN-0411 **Collected:** 10/7/2020 **Lab ID:** 062019401-0111

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	10/27/2020	DI	10/29/2020	AL

Client Sample Description WYAN-0412 **Collected:** 10/7/2020 **Lab ID:** 062019401-0112

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	10/27/2020	DI	10/29/2020	AL

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062019401

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Tara Ricker**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 10/15/2020 12:24 PM
 Collected: 10/7/2020

Project: #19-45375, Martin Luther King Elementary School, Wyandanch Union Free School District, 792 Mount Avenue, Wyandanch NY 11798

Analytical Results

Client Sample Description WYAN-0413 **Collected:** 10/7/2020 **Lab ID:** 062019401-0113

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.9 J	3.0 µg/L	10/27/2020	DI	10/29/2020	AL
Lead MDL: 1.0µg/L							

Client Sample Description WYAN-0414 **Collected:** 10/7/2020 **Lab ID:** 062019401-0114

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.4 J	3.0 µg/L	10/27/2020	DI	10/29/2020	AL
Lead MDL: 1.0µg/L							

Client Sample Description WYAN-0415 **Collected:** 10/7/2020 **Lab ID:** 062019401-0115

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.1	3.0 µg/L	10/27/2020	DI	10/29/2020	AL

Client Sample Description WYAN-0416 **Collected:** 10/7/2020 **Lab ID:** 062019401-0116

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.9 J	3.0 µg/L	10/27/2020	DI	10/29/2020	AL
Lead MDL: 1.0µg/L							

Client Sample Description WYAN-0417 **Collected:** 10/7/2020 **Lab ID:** 062019401-0117

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.6 J	3.0 µg/L	10/27/2020	DI	10/29/2020	AL
Lead MDL: 1.0µg/L							

Client Sample Description WYAN-0418 **Collected:** 10/7/2020 **Lab ID:** 062019401-0118

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.2	3.0 µg/L	10/27/2020	DI	10/29/2020	AL

Client Sample Description WYAN-0448 **Collected:** 10/7/2020 **Lab ID:** 062019401-0119

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	120	3.0 µg/L	10/27/2020	DI	10/29/2020	AL



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>

carleplacelab@emsl.com

EMSL Order:	062019401
CustomerID:	JCBR50
CustomerPO:	
ProjectID:	

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL.

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45375
Building: Martin Luther King Elementary School
MLKES

Client: Wyandanch Union Free School District
Retest/New Install ☐
Turn Around: Normal 1 wk Rush _____

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
WYAN-0261	CR	1052	Room 14	DW	12/9/2020	6:35:00 AM
WYAN-0283	KI	1030	Kitchen	KC	12/9/2020	6:32:00 AM
WYAN-0297	BR	1017B	Room 2 Bathroom	BF	12/9/2020	6:47:00 AM
WYAN-0299	CR	1018	Room 3	DW	12/9/2020	6:49:00 AM
WYAN-0331	CR	2009	Room 22	CF	12/9/2020	6:38:00 AM
WYAN-0334	CR	2008	Room 23	DW	12/9/2020	6:41:00 AM
WYAN-0341	CR	2004	Room 27	CF	12/9/2020	6:43:00 AM
WYAN-0357	BR	N/A	Women's Bathroom	BF	12/9/2020	6:52:00 AM
WYAN-0362	OF/KI	N/A	Main Office Kitchen	SN	12/9/2020	6:54:00 AM
WYAN-0403	BR	N/A	Gym Locker Room Bathroom	BF	12/9/2020	7:02:00 AM
WYAN-0448	ST	New Construction	Cafeteria Serving Area Storage Room	KC	12/9/2020	6:59:00 AM

Samples Submitted 11

Building Address
792 Mount Avenue
Wyandanch, NY 11798

Pb200.5 -
A. Lumy 12/22/20

Analysis Type: ELAP 200.5 @
Lab Received: *Unique McKay*
Signature: *um* 12/10/20

Samplers Name: *Alexandria Orllassino*
Samplers Signature: *A Orllassino*
JCB Project Manager: *Tara Ricker*

062022898



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Tara Ricker
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

12/29/2020

Phone: (631) 584-5492
Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 12/10/2020. The results are tabulated on the attached data pages for the following client designated project:

**Martin Luther King Elementary School, 792 Mount Avenue,
Wyandanch, NY 11798, Wyandanch Union Free School, District,
10.15375**

The reference number for these samples is EMSL Order #062022898. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Alger Liang, Lead Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062022898

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Tara Ricker**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 12/10/2020 03:50 PM
 Collected: 12/9/2020

Project: **Martin Luther King Elementary School, 792 Mount Avenue, Wyandanch, NY 11798, Wyandanch Union Free School, District, 19-45375**

Analytical Results

Client Sample Description WYAN-0261 **Collected:** 12/9/2020 **Lab ID:** 062022898-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	15	3.0 µg/L	12/22/2020	DI	12/22/2020	AL

Client Sample Description WYAN-0283 **Collected:** 12/9/2020 **Lab ID:** 062022898-0002

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	29	3.0 µg/L	12/22/2020	DI	12/22/2020	AL

Client Sample Description WYAN-0297 **Collected:** 12/9/2020 **Lab ID:** 062022898-0003

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	770 D	30 µg/L	12/22/2020	DI	12/22/2020	AL

Client Sample Description WYAN-0299 **Collected:** 12/9/2020 **Lab ID:** 062022898-0004

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.9 J	3.0 µg/L	12/22/2020	DI	12/22/2020	AL

Lead MDL: 1.0µg/L

Client Sample Description WYAN-0331 **Collected:** 12/9/2020 **Lab ID:** 062022898-0005

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.0 J	3.0 µg/L	12/22/2020	DI	12/22/2020	AL

Lead MDL: 1.0µg/L

Client Sample Description WYAN-0334 **Collected:** 12/9/2020 **Lab ID:** 062022898-0006

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	9.9	3.0 µg/L	12/22/2020	DI	12/22/2020	AL

Client Sample Description WYAN-0341 **Collected:** 12/9/2020 **Lab ID:** 062022898-0007

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	32	3.0 µg/L	12/22/2020	DI	12/22/2020	AL

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062022898

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Tara Ricker**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
Fax:
Received: 12/10/2020 03:50 PM
Collected: 12/9/2020

Project: **Martin Luther King Elementary School, 792 Mount Avenue, Wyandanch, NY 11798, Wyandanch Union Free School, District, 19-45375**

Analytical Results

Client Sample Description WYAN-0357 **Collected:** 12/9/2020 **Lab ID:** 062022898-0008

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	18	3.0 µg/L	12/22/2020	DI	12/22/2020	AL

Client Sample Description WYAN-0362 **Collected:** 12/9/2020 **Lab ID:** 062022898-0009

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.6	3.0 µg/L	12/22/2020	DI	12/22/2020	AL

Client Sample Description WYAN-0403 **Collected:** 12/9/2020 **Lab ID:** 062022898-0010

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	27	3.0 µg/L	12/22/2020	DI	12/22/2020	AL

Client Sample Description WYAN-00448 **Collected:** 12/9/2020 **Lab ID:** 062022898-0011

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4200 D	60 µg/L	12/22/2020	DI	12/22/2020	AL

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL.

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45375

Building: Milton L. Olive Middle School

MLOMS

Client:

Wyandanch Union Free School District

Retest/New Install []

Turn Around: Normal 1 wk. Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
WYAN-0147	KI	1031B	Cafeteria Kitchen	KC	10/9/2020	5:04:00 AM
WYAN-0148	KI	1031B	Cafeteria Kitchen	KC	10/9/2020	5:05:00 AM
WYAN-0149	KI	1031B	Cafeteria Kitchen	IM	10/9/2020	5:06:00 AM
WYAN-0150	KI	1031B	Cafeteria Kitchen	KC	10/9/2020	5:07:00 AM
WYAN-0151	KI	1031B	Cafeteria Kitchen	KC	10/9/2020	5:09:00 AM
WYAN-0152	KI	1031B	Cafeteria Kitchen	KC	10/9/2020	5:10:00 AM
WYAN-0153	KI	1031B	Cafeteria Kitchen	SN	10/9/2020	5:11:00 AM
WYAN-0154	BR	1031B2B	Cafeteria Kitchen Exit Vestibule Can Wash	BF	10/9/2020	5:12:00 AM
WYAN-0155	HA	1038	Corridor Gym to Main Lobby (By Stage - 1033A)	WF	10/9/2020	5:15:00 AM
WYAN-0158	BR	1034A	Nurse's Office Bathroom	BF	10/9/2020	5:16:00 AM
WYAN-0163	HA	1067	Corridor Server Closet to Room 16 (Outside Girls' Bathroom - 1056)	WF	10/9/2020	5:21:00 AM
WYAN-0168	CR	N/A	Portable Classroom P2	WC	10/9/2020	5:24:00 AM
WYAN-0170	BR	N/A	Custodial Closet	BF	10/9/2020	5:26:00 AM
WYAN-0171	CR	N/A	Classroom P4	WC	10/9/2020	5:28:00 AM
WYAN-0172	BR	N/A	Classroom P4 Bathroom	BF	10/9/2020	5:29:00 AM
WYAN-0174	BR	N/A	Classroom P6 Bathroom	BF	10/9/2020	5:30:00 AM
WYAN-0176	BR	N/A	Classroom P5 Bathroom	BF	10/9/2020	5:33:00 AM
WYAN-0177	CR	N/A	Classroom P3	WC	10/9/2020	5:34:00 AM

Building Address

140 Garden City Avenue

Wyandanch, NY 11798

Analysis Type: ELAP 200.5

Lab Recieved:

Signature:

Samplers Name: Jose Roldan

Samplers Signature:

JCB Project Manager: Tara Rickel

OrderID: 062019061

Page 1 of 2



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45375

Building: Milton L. Olive Middle School

MLOMS

Client:

Wyandanch Union Free School District

Retest/New Install ☒

Turn Around: Normal 1 wk Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
WYAN-0178	BR	N/A	Classroom P3 Bathroom	BF	10/9/2020	5:35:00 AM
WYAN-0179	CR	N/A	Classroom P1	WC	10/9/2020	5:36:00 AM
WYAN-0180	BR	N/A	Classroom P1 Bathroom	BF	10/9/2020	5:37:00 AM
WYAN-0189	BR	1040B	Room 1 Shop Bathroom	BF	10/9/2020	5:41:00 AM
WYAN-0190	BR	1033D1A	Gym Vestibule PE Office Bathroom	BF	10/9/2020	5:52:00 AM
WYAN-0191	LR	1033C	Gym Girl's Locker Room	DW	10/9/2020	5:56:00 AM
WYAN-0193	OF	1033B1	Gym Vestibule Boy's PE Office	BW	10/9/2020	5:59:00 AM
WYAN-0194	OF	1033B1	Gym Vestibule Boy's PE Office	BW	10/9/2020	6:00:00 AM
WYAN-0195	BR	1033C2	Gym Girl's Locker Room Bathroom	BF	10/9/2020	6:08:00 AM
WYAN-0211	SP	1019	Room 18	CF	10/9/2020	6:09:00 AM
WYAN-0212	SP	1019	Room 18	CF	10/9/2020	6:10:00 AM
WYAN-0213	HE	1017	Home Economics Room 20	EC	10/9/2020	6:13:00 AM
WYAN-0214	HE	1017	Home Economics Room 20	EC	10/9/2020	6:14:00 AM
WYAN-0231	HA	1030	Corridor Attendance to Stairwell (Outside Room 22 - 1013)	WF	10/9/2020	6:21:00 AM
WYAN-0233	HA	2018	2nd Floor Corridor (Outside Room 40 - 2004)	WF	10/9/2020	6:22:00 AM
WYAN-0244	BR	2017A	Staff Lounge Corridor Women's Faculty Bathroom	BF	10/9/2020	6:28:00 AM
WYAN-0245	BR	2017B	Staff Lounge Corridor Men's Faculty Bathroom	BF	10/9/2020	6:29:00 AM

Samples Submitted 35

Building Address

140 Garden City Avenue

Wyandanch, NY 11798

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Samplers Name: Jose Roldan

Samplers Signature:

JCB Project Manager: Tara Richter

062019061

10/9/20 1227 PM



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

**Tara Ricker
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788**

11/30/2020

Phone: (631) 584-5492

Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 10/9/2020. The results are tabulated on the attached data pages for the following client designated project:

**Wyandanch Union Free School District, Milton L. Olive Middle
School, MLOMS, 140 Garden City Avenue, Wyandanch, NY
11798 #19-15375**

The reference number for these samples is EMSL Order #062019061. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Alger Liang, Lead Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062019061

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Tara Ricker**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 10/9/2020 12:27 PM
 Collected: 10/9/2020

Project: Wyandanch Union Free School District, Milton L. Olive Middle School, MLOMS, 140 Garden City Avenue, Wyandanch, NY 11798, #:19-

Analytical Results

Client Sample Description		WYAN-0147	Collected:	10/9/2020	Lab ID:	062019061-0001		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.9	3.0	µg/L	10/19/2020	DI	10/21/2020	AM
Client Sample Description		WYAN-0148	Collected:	10/9/2020	Lab ID:	062019061-0002		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.9 J	3.0	µg/L	10/19/2020	DI	10/21/2020	AM
		Lead MDL: 1.0µg/L						
Client Sample Description		WYAN-0149	Collected:	10/9/2020	Lab ID:	062019061-0003		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	10/19/2020	DI	10/21/2020	AM
Client Sample Description		WYAN-0150	Collected:	10/9/2020	Lab ID:	062019061-0004		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	8.7	3.0	µg/L	10/19/2020	DI	10/21/2020	AM
Client Sample Description		WYAN-0151	Collected:	10/9/2020	Lab ID:	062019061-0005		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.4 J	3.0	µg/L	10/19/2020	DI	10/21/2020	AM
		Lead MDL: 1.0µg/L						
Client Sample Description		WYAN-0152	Collected:	10/9/2020	Lab ID:	062019061-0006		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	9.2	3.0	µg/L	10/19/2020	DI	10/21/2020	AM
Client Sample Description		WYAN-0153	Collected:	10/9/2020	Lab ID:	062019061-0007		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	9.0	3.0	µg/L	10/19/2020	DI	10/21/2020	AM

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062019061

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Tara Ricker**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 10/9/2020 12:27 PM
 Collected: 10/9/2020

Project: **Wyandanch Union Free School District, Milton L. Olive Middle School, MLOMS, 140 Garden City Avenue, Wyandanch, NY 11798, #:19-**

Analytical Results

Client Sample Description WYAN-0154 **Collected:** 10/9/2020 **Lab ID:** 062019061-0008

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	17	3.0 µg/L	10/19/2020	DI	10/21/2020	AM

Client Sample Description WYAN-0155 **Collected:** 10/9/2020 **Lab ID:** 062019061-0009

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	10/19/2020	DI	10/21/2020	AM

Client Sample Description WYAN-0158 **Collected:** 10/9/2020 **Lab ID:** 062019061-0010

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.2	3.0 µg/L	10/19/2020	DI	10/21/2020	AM

Client Sample Description WYAN-0163 **Collected:** 10/9/2020 **Lab ID:** 062019061-0011

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	10/19/2020	DI	10/21/2020	AM

Client Sample Description WYAN-0168 **Collected:** 10/9/2020 **Lab ID:** 062019061-0012

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.2 J	3.0 µg/L	10/19/2020	DI	10/21/2020	AM

Lead MDL: 1.0µg/L

Client Sample Description WYAN-0170 **Collected:** 10/9/2020 **Lab ID:** 062019061-0013

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.0 J	3.0 µg/L	10/19/2020	DI	10/21/2020	AM

Lead MDL: 1.0µg/L

Client Sample Description WYAN-0171 **Collected:** 10/9/2020 **Lab ID:** 062019061-0014

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	10/19/2020	DI	10/21/2020	AM

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062019061

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Tara Ricker**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 10/9/2020 12:27 PM
 Collected: 10/9/2020

Project: **Wyandanch Union Free School District, Milton L. Olive Middle School, MLOMS, 140 Garden City Avenue, Wyandanch, NY 11798, #:19-**

Analytical Results

Client Sample Description		WYAN-0172	Collected:	10/9/2020	Lab ID:	062019061-0015		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	10/19/2020	DI	10/21/2020	AM
Client Sample Description		WYAN-0174	Collected:	10/9/2020	Lab ID:	062019061-0016		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	10/19/2020	DI	10/21/2020	AM
Client Sample Description		WYAN-0176	Collected:	10/9/2020	Lab ID:	062019061-0017		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	16	3.0	µg/L	10/19/2020	DI	10/21/2020	AM
Client Sample Description		WYAN-0177	Collected:	10/9/2020	Lab ID:	062019061-0018		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	10/19/2020	DI	10/21/2020	AM
Client Sample Description		WYAN-0178	Collected:	10/9/2020	Lab ID:	062019061-0019		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.6	3.0	µg/L	10/19/2020	DI	10/21/2020	AM
Client Sample Description		WYAN-0179	Collected:	10/9/2020	Lab ID:	062019061-0020		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.7 J	3.0	µg/L	10/19/2020	DI	10/21/2020	AM
Lead MDL: 1.0µg/L								
Client Sample Description		WYAN-0180	Collected:	10/9/2020	Lab ID:	062019061-0021		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.6 J	3.0	µg/L	10/19/2020	DI	10/21/2020	AM
Lead MDL: 1.0µg/L								

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062019061

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Tara Ricker**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 10/9/2020 12:27 PM
 Collected: 10/9/2020

Project: **Wyandanch Union Free School District, Milton L. Olive Middle School, MLOMS, 140 Garden City Avenue, Wyandanch, NY 11798, #:19-**

Analytical Results

Client Sample Description WYAN-0189 **Collected:** 10/9/2020 **Lab ID:** 062019061-0022

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6700 D	150 µg/L	10/19/2020	DI	10/21/2020	AM

Client Sample Description WYAN-0190 **Collected:** 10/9/2020 **Lab ID:** 062019061-0023

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	720 D	30 µg/L	10/19/2020	DI	10/21/2020	AM

Client Sample Description WYAN-0191 **Collected:** 10/9/2020 **Lab ID:** 062019061-0024

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.2	3.0 µg/L	10/19/2020	DI	10/21/2020	AM

Client Sample Description WYAN-0193 **Collected:** 10/9/2020 **Lab ID:** 062019061-0025

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	10/19/2020	DI	10/21/2020	AM

Client Sample Description WYAN-0194 **Collected:** 10/9/2020 **Lab ID:** 062019061-0026

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	10/19/2020	DI	10/21/2020	AM

Client Sample Description WYAN-0195 **Collected:** 10/9/2020 **Lab ID:** 062019061-0027

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	110	3.0 µg/L	10/19/2020	DI	10/21/2020	AM

Client Sample Description WYAN-0211 **Collected:** 10/9/2020 **Lab ID:** 062019061-0028

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.5 J	3.0 µg/L	10/19/2020	DI	10/21/2020	AM

Lead MDL: 1.0µg/L

Client Sample Description WYAN-0212 **Collected:** 10/9/2020 **Lab ID:** 062019061-0029

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062019061

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Tara Ricker**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 10/9/2020 12:27 PM
 Collected: 10/9/2020

Project: **Wyandanch Union Free School District, Milton L. Olive Middle School, MLOMS, 140 Garden City Avenue, Wyandanch, NY 11798, #:19-**

Analytical Results

Client Sample Description		WYAN-0212	Collected:	10/9/2020	Lab ID:	062019061-0029		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 J	3.0	µg/L	10/19/2020	DI	10/21/2020	AM
Client Sample Description		WYAN-0213	Collected:	10/9/2020	Lab ID:	062019061-0030		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	18	3.0	µg/L	10/19/2020	DI	10/21/2020	AM
Client Sample Description		WYAN-0214	Collected:	10/9/2020	Lab ID:	062019061-0031		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.8	3.0	µg/L	10/19/2020	DI	10/21/2020	AM
Client Sample Description		WYAN-0231	Collected:	10/9/2020	Lab ID:	062019061-0032		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	10/19/2020	DI	10/21/2020	AM
Client Sample Description		WYAN-0233	Collected:	10/9/2020	Lab ID:	062019061-0033		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.2 J	3.0	µg/L	10/19/2020	DI	10/21/2020	AM
		Lead MDL: 1.0µg/L						
Client Sample Description		WYAN-0244	Collected:	10/9/2020	Lab ID:	062019061-0034		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	15	3.0	µg/L	10/19/2020	DI	10/21/2020	AM
Client Sample Description		WYAN-0245	Collected:	10/9/2020	Lab ID:	062019061-0035		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	13	3.0	µg/L	10/19/2020	DI	10/21/2020	AM



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>

carleplacelab@emsl.com

EMSL Order:	062019061
CustomerID:	JCBR50
CustomerPO:	
ProjectID:	

Definitions:


MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL.

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



062022652 Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45375

Building: Milton L. Olive Middle School

MLOMS

Client:

Wyandanch Union Free School District

Retest: New Install

Turn Around: Normal 1 wk Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
WYAN-0154	BR	1031B2B	Cafeteria Kitchen Exit Vestibule Can Wash	BF	12/9/2020	6:03:00 AM
WYAN-0176	BR	N/A	Classroom P5 Bathroom	BF	12/9/2020	6:08:00 AM
WYAN-0189	BR	1040B	Room 1 Shop Bathroom	BF	12/9/2020	6:14:00 AM
WYAN-0190	BR	1033D1A	Gym Vestibule PE Office Bathroom	BF	12/9/2020	6:16:00 AM
WYAN-0195	BR	1033B1A	Gym Vestibule Boy's PE Office Bathroom	BF	12/9/2020	6:19:00 AM
WYAN-0213	HE	1017	Home Economics Room 20	EC	12/9/2020	6:05:00 AM

Samples Submitted 6

20 DEC -9 PM 3:46

ANALYTICAL, INC.
CARLE PLACE, NY**Building Address**

140 Garden City Avenue

Wyandanch, NY 11798

Auppa McDonald 12/11/20

Analysis Type: ELAP 200.5

Lab Received: Unique McKay

Signature: um blab20 @ 346pm

Samplers Name: Alexandria Orlassino

Samplers Signature: AOrlassino

JCB Project Manager: Tara Ricker



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Tara Ricker
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

12/21/2020

Phone: (631) 584-5492

Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 12/9/2020. The results are tabulated on the attached data pages for the following client designated project:

Milton L. Olive Middle School, 140 Garden City Avenue,
Wyandanch, NY 11798, Wyandanch Union Free School District,
10-15375

The reference number for these samples is EMSL Order #062022652. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Alger Liang, Lead Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062022652

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Tara Ricker**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 12/9/2020 03:46 PM
 Collected: 12/9/2020

Project: **Milton L. Olive Middle School, 140 Garden City Avenue, Wyandanch, NY 11798, Wyandanch Union Free School District, 19-45375**

Analytical Results

Client Sample Description		WYAN-0154	Collected:		12/9/2020 6:06:00 AM	Lab ID:	062022652-0001	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.7 J	3.0	µg/L	12/10/2020	AM	12/11/2020	AM
Lead MDL: 1.0µg/L								
Client Sample Description		WYAN-0176	Collected:		12/9/2020 6:06:00 AM	Lab ID:	062022652-0002	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.8 J	3.0	µg/L	12/10/2020	AM	12/11/2020	AM
Lead MDL: 1.0µg/L								
Client Sample Description		WYAN-0189	Collected:		12/9/2020 6:06:00 AM	Lab ID:	062022652-0003	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	31000 D	600	µg/L	12/10/2020	AM	12/11/2020	AM
Client Sample Description		WYAN-0190	Collected:		12/9/2020 6:06:00 AM	Lab ID:	062022652-0004	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	140	3.0	µg/L	12/10/2020	AM	12/11/2020	AM
Client Sample Description		WYAN-0195	Collected:		12/9/2020 6:06:00 AM	Lab ID:	062022652-0005	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.8	3.0	µg/L	12/10/2020	AM	12/11/2020	AM
Client Sample Description		WYAN-0213	Collected:		12/9/2020 6:06:00 AM	Lab ID:	062022652-0006	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	13	3.0	µg/L	12/10/2020	AM	12/11/2020	AM

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL.

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45375

Building: Wyandanch Bus Garage

WBG

062 019387

Page 1 of 1

Client:

Wyandanch Union Free School District

Retest/New Install []

Turn Around Normal 1 wk Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Notes	Sample Date	Sample Time
WYAN-0252	GA	1007	Main Garage (By Dispatch Office - 1001)	WC		10/7/20	6:08
WYAN-0254	BR	1002	Restroom	BF		10/7/20	6:07

2

RECEIVED
ENVIRONMENTAL ANALYTICAL, INC.
CARLE PLACE, NY
20 OCT 15 AM 11:44

Building Address

790 Mount Avenue

Wyandanch, NY 11798

Analysis Type: ELAP 2005

Lab Received:

Signature:

Samplers Name: Zachary Steles

Samplers Signature: [Signature]

JCB Project Manager: Tara Ricker

Auppa McDonald 10/21/20

OrderID: 062019387



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

**Tara Ricker
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788**

11/30/2020

Phone: (631) 584-5492
Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 10/15/2020. The results are tabulated on the attached data pages for the following client designated project:

**19-45375, Wyandanch Bus Garage, Wyandanch Union Free
School District, 790 Mount Avenue, Wyandanch, NY 11798**

The reference number for these samples is EMSL Order #062019387. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Alger Liang, Lead Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062019387

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Tara Ricker**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
Fax:
Received: 10/15/2020 11:44 AM
Collected: 10/7/2020

Project: 19-45375, Wyandanch Bus Garage, Wyandanch Union Free School District, 790 Mount Avenue, Wyandanch, NY 11798

Analytical Results

Client Sample Description WYAN-0252 **Collected:** 10/7/2020 **Lab ID:** 062019387-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	10/19/2020	DI	10/21/2020	AM

Client Sample Description WYAN-0254 **Collected:** 10/7/2020 **Lab ID:** 062019387-0002

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.5	3.0 µg/L	10/19/2020	DI	10/21/2020	AM

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL.


RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted

062 09497

OrderID: 062019497

Page 1 of 1



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45375

Building: Wyandanch Central Administration

WCA

Client:

Wyandanch Union Free School District

Retest/New Install ☐Turn Around: Normal 1 wk Rush _____

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
WYAN-0419	BR	1019	Men's Bathroom	BF	10/7/2020	6:37:00 AM
WYAN-0420	BR	1019	Men's Bathroom	BF	10/7/2020	6:37:00 AM
WYAN-0421	BR	1018	Women's Bathroom	BF	10/7/2020	6:36:00 AM
WYAN-0422	BR	1018	Women's Bathroom	BF	10/7/2020	3:36:00 AM
WYAN-0429	HA	1015	Main Corridor & Lobby (Outside Men's Restroom - 1011)	WC	10/7/2020	6:29:00 AM
WYAN-0430	KI	1009B	Administration Kitchen	KC	10/7/2020	6:24:00 AM
WYAN-0431	HA	1015	Main Corridor & Lobby (Outside Superintendents Office - 1002)	WC	10/7/2020	6:27:00 AM
WYAN-0435	KI/OF	1006B1	Office Kitchen	KC	10/7/2020	6:25:00 AM
WYAN-0436	KI/OF	1006B1	Office Kitchen	SN	10/7/2020	6:25:00 AM

Samples Submitted 9

20 OCT 16 PM 1:56

JCB ANALYTICAL, INC.
CARLE PLACE, NYPb200.5 - *Alger Lundy* 11/04/20**Building Address**

1445 Dr. Martin Luther King Jr. Boulevard

Wyandanch, NY 11798

Analysis Type: ELAP.200.5

Lab Received: *Chelle*Signature: *[Signature]*Samplers Name: *Zachary Strobel*Samplers Signature: *[Signature]*JCB Project Manager: *Tara Ricker*



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

**Tara Ricker
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788**

11/30/2020

Phone: (631) 584-5492

Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 10/16/2020. The results are tabulated on the attached data pages for the following client designated project:

**#19-45375, Wyandanch Central Administration, Wyandanch
Union Free School District, 1445 Dr. Martin Luther King Jr.
Boulevard, Wyandanch, NY 11798**

The reference number for these samples is EMSL Order #062019497. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Alger Liang, Lead Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062019497

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Tara Ricker**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 10/16/2020 01:56 PM
 Collected: 10/7/2020

Project: #19-45375, Wyandanch Central Administration, Wyandanch Union Free School District, 1445 Dr. Martin Luther King Jr. Boulevard,

Analytical Results

Client Sample Description WYAN-0419 **Collected:** 10/7/2020 **Lab ID:** 062019497-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.8	3.0 µg/L	11/3/2020	DI	11/4/2020	AL

Client Sample Description WYAN-0420 **Collected:** 10/7/2020 **Lab ID:** 062019497-0002

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	7.2	3.0 µg/L	11/3/2020	DI	11/4/2020	AL

Client Sample Description WYAN-0421 **Collected:** 10/7/2020 **Lab ID:** 062019497-0003

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.5	3.0 µg/L	11/3/2020	DI	11/4/2020	AL

Client Sample Description WYAN-0422 **Collected:** 10/7/2020 **Lab ID:** 062019497-0004

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.6 J	3.0 µg/L	11/3/2020	DI	11/4/2020	AL

Lead MDL: 1.0µg/L

Client Sample Description WYAN-0429 **Collected:** 10/7/2020 **Lab ID:** 062019497-0005

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	7.4	3.0 µg/L	11/3/2020	DI	11/4/2020	AL

Client Sample Description WYAN-0430 **Collected:** 10/7/2020 **Lab ID:** 062019497-0006

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	14	3.0 µg/L	11/3/2020	DI	11/4/2020	AL

Client Sample Description WYAN-0431 **Collected:** 10/7/2020 **Lab ID:** 062019497-0007

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.7	3.0 µg/L	11/3/2020	DI	11/4/2020	AL

Client Sample Description WYAN-0435 **Collected:** 10/7/2020 **Lab ID:** 062019497-0008

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062019497

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Tara Ricker**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
Fax:
Received: 10/16/2020 01:56 PM
Collected: 10/7/2020

Project: #19-45375, Wyandanch Central Administration, Wyandanch Union Free School District, 1445 Dr. Martin Luther King Jr. Boulevard,

Analytical Results

Client Sample Description WYAN-0435 **Collected:** 10/7/2020 **Lab ID:** 062019497-0008

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	23	3.0 µg/L	11/3/2020	DI	11/4/2020	AL

Client Sample Description WYAN-0436 **Collected:** 10/7/2020 **Lab ID:** 062019497-0009

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.5	3.0 µg/L	11/3/2020	DI	11/4/2020	AL

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL.

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



062022840 Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45375
Building: Wyandanch Central Administration
WCA

Client:
Wyandanch Union Free School District

~~Retest~~ New Install | 1
Turn Around: Normal 1 wk Rush _____

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
WYAN-0435	KI/OF	1006B1	Office Kitchen	KC	12/9/2020	7:08:00 AM

Samples Submitted 1

RECEIVED
ANALYTICAL INC.
CARLE PLACE, NY
20 DEC - 9 PM 3:45

Building Address

1445 Dr. Martin Luther King Jr. Boulevard
Wyandanch, NY 11798

Alexandra Orlassino 12/11/20

Analysis Type: ELAP 200.5

Lab Reclaimed: *Unique Mexico*

Signature: *Lim 12/9/20 @ 3:45 PM*

Samplers Name: *Alexandria Orlassino*

Samplers Signature: *A Orlassino*

JCB Project Manager: *Tara Ricker*



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

**Tara Ricker
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788**

12/21/2020

Phone: (631) 584-5492

Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 12/9/2020. The results are tabulated on the attached data pages for the following client designated project:

**Wyandanch Central Administration, 145 Dr. Martin Luther King
Jr. Boulevard, Wyandanch, NY 11798, 19-45375**

The reference number for these samples is EMSL Order #062022840. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Alger Liang, Lead Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062022840

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Tara Ricker**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
Fax:
Received: 12/9/2020 03:45 PM
Collected: 12/9/2020

Project: **Wyandanch Central Administration, 145 Dr. Martin Luther King Jr. Boulevard, Wyandanch, NY 11798, 19-45375**

Analytical Results

Client Sample Description WYAN-0435 **Collected:** 12/9/2020 **Lab ID:** 062022840-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	12	3.0 µg/L	12/10/2020	AM	12/11/2020	AM

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL.

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45375
Building: Wyandanch Memorial High School
WMHS

062018953

Page 1 of 3

Client: Wyandanch Union Free School District

Retest/New Install []
Turn Around: Normal 1 wk Rush _____

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
WYAN-0001	BR	1020A1	Boys Locker Room Vestibule Bathroom	BF	10/8/2020	6:02:00 AM
WYAN-0002	OF	1020D	Boys Locker Room Coach's Office	BW	10/8/2020	6:03:00 AM
WYAN-0003	BR	1020D1	Boys' Locker Room Coach's Office Bathroom	BF	10/8/2020	6:04:00 AM
WYAN-0007	HA	1024	Corridor Auditorium Stage To Girls Bathroom (Outside Boys' Locker Room - 1020)	WF	10/8/2020	6:06:00 AM
WYAN-0011	BR	1025A1	Girls' Locker Room Coach's Office Bathroom	BF	10/8/2020	6:08:00 AM
WYAN-0012	LR	1032	Girls Locker Room	WF	10/8/2020	6:09:00 AM
WYAN-0013	LR	1032	Girls Locker Room	WC	10/8/2020	6:10:00 AM
WYAN-0014	BR	1032A1	Girls Locker Room Exit Vestibule Bathroom	BF	10/8/2020	6:12:00 AM
WYAN-0015	KI	1028	Kitchen	KC	10/8/2020	5:10:00 AM
WYAN-0016	KI	1028	Kitchen	KC	10/8/2020	5:11:00 AM
WYAN-0017	KI	1028	Kitchen	KC	10/8/2020	5:12:00 AM
WYAN-0018	KI	1028	Kitchen	SN	10/8/2020	5:13:00 AM
WYAN-0019	KI	1028	Kitchen	KC	10/8/2020	5:15:00 AM
WYAN-0020	KI	1028	Kitchen	IM	10/8/2020	5:16:00 AM
WYAN-0021	KI	1028	Kitchen	KC	10/8/2020	5:17:00 AM
WYAN-0022	KI	1028	Kitchen	KC	10/8/2020	5:18:00 AM
WYAN-0023	KI	1028	Kitchen	SN	10/8/2020	5:20:00 AM
WYAN-0024	BR	1028D	Kitchen Dietician Office	BF	10/8/2020	5:24:00 AM

Building Address

54 South 32nd Street

Wyandanch, NY 11798

Pb 200.5
A. Lung 10/14/20

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Samplers Name: Jose Poldan

Samplers Signature:

JCB Project Manager: Tara Ricker

MS-AVALANCHE, INC.
GIRL: PLACER, NY
10/12/20
P1 12:24



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45375

Building: Wyandanch Memorial High School
WMHS

062018953

Page 2 of 3

Client:

Wyandanch Union Free School District

Retest/New Install ☐

Turn Around: Normal 1 wk Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
WYAN-0034	BR	1033A	Food Service Suite Bathroom	BF	10/8/2020	5:26:00 AM
WYAN-0035	NO	1034	Nurse's Vestibule	NS	10/8/2020	5:27:00 AM
WYAN-0036	BR	1035	Security Vestibule	BF	10/8/2020	5:28:00 AM
WYAN-0037	OF	1036A	Athletic Vestibule Bathroom	CF	10/8/2020	5:29:00 AM
WYAN-0038	BR	1037B	Custodial Office Bathroom	BF	10/8/2020	5:31:00 AM
WYAN-0039	BR	1056F	Main Office Bathroom	BF	10/8/2020	5:33:00 AM
WYAN-0040	HA	1060	Main Lobby	WF	10/8/2020	5:34:00 AM
WYAN-0042	OF	1054A	Central Registration/Attendance Office	KC	10/8/2020	5:36:00 AM
WYAN-0052	HA	1055	Corridor Central Registration to Room 119 (By Elevator)	WF	10/8/2020	5:37:00 AM
WYAN-0063	HE	1067	Home Economics Room 105	EC	10/8/2020	5:39:00 AM
WYAN-0064	HE	1067	Room 105	SN	10/8/2020	5:40:00 AM
WYAN-0065	HE	1067B	Home Economics Room 105 Office	EC	10/8/2020	5:41:00 AM
WYAN-0066	HE	1067B	Home Economics Room 105 Office	SN	10/8/2020	5:42:00 AM
WYAN-0069	FL	1069	Faculty Room 103	KC	10/8/2020	5:44:00 AM
WYAN-0070	FL	1069	Faculty Room 103	SN	10/8/2020	5:45:00 AM
WYAN-0071	HA	1075	Corridor Guidance to Main Lobby (Outside Faculty Room 103 - 1069)	WF	10/8/2020	5:46:00 AM
WYAN-0073	HA	2027	Corridor Science Lab 200 To Room 219 (By Science Lab 201 - 2024)	WF	10/8/2020	5:53:00 AM
WYAN-0101	HA	2027	Corridor Science Lab 200 To Room 219 (Outside Athletic Director's Suite 223 - 2013)	WF	10/8/2020	5:50:00 AM

Building Address

54 South 32nd Street
Wyandanch, NY 11798

Pb 200.5

A. Jany 10/14/20

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Samplers Name: Jose Roldan

Samplers Signature:

JCB Project Manager: Tara Pickett

OrderID: 062018953



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45375

Building: Wyandanch Memorial High School
WMHS

062018953

Client:

Wyandanch Union Free School District

Retest/New Install ☐

Turn Around: Normal 1 wk Rush ☐

Page 3 of 3

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
WYAN-0126	SP/CR	2009	Art Room 213	CF	10/8/2020	5:55:00 AM
WYAN-0136	HA	2027	Corridor Science Lab 200 To Room 219 (By Elevator)	WF	10/8/2020	5:56:00 AM

Samples Submitted 38

Building Address

54 South 32nd Street

Wyandanch, NY 11798

Pb 200.5

A. Lundy 10/14/20

Analysis Type: ELAP 200.5

Lab Received:

Signature:

[Signature]

Samplers Name: Jose Roldan

Samplers Signature:

JCB Project Manager: Tara Ricker

RECEIVED
E.I.S.L. ANALYTICAL, INC.
CARLE PLACE NY
20 OCT -8 PM 12:24

OrderID: 062018953



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Tara Ricker
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

11/30/2020

Phone: (631) 584-5492
Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 10/8/2020. The results are tabulated on the attached data pages for the following client designated project:

#19-45375, Wyandanch Memorial High School, Wyandanch Union
Free School District, 54 South 32nd Street, Wyandanch, NY 11798

The reference number for these samples is EMSL Order #062018953. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Alger Liang, Lead Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062018953

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Tara Ricker**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 10/8/2020 12:24 PM
 Collected: 10/8/2020

Project: #19-45375, Wyandanch Memorial High School, Wyandanch Union Free School District, 54 South 32nd Street, Wyandanch, NY 11798

Analytical Results

Client Sample Description		WYAN-0001	Collected:		10/8/2020	Lab ID:		062018953-0001
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.8 J	3.0	µg/L	10/12/2020	DI	10/14/2020	AL
Lead MDL: 1.0µg/L								
Client Sample Description		WYAN-0002	Collected:		10/8/2020	Lab ID:		062018953-0002
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	10/12/2020	DI	10/14/2020	AL
Client Sample Description		WYAN-0003	Collected:		10/8/2020	Lab ID:		062018953-0003
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	31	3.0	µg/L	10/12/2020	DI	10/14/2020	AL
Client Sample Description		WYAN-0007	Collected:		10/8/2020	Lab ID:		062018953-0004
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	10/12/2020	DI	10/14/2020	AL
Client Sample Description		WYAN-0011	Collected:		10/8/2020	Lab ID:		062018953-0005
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	84	3.0	µg/L	10/12/2020	DI	10/14/2020	AL
Client Sample Description		WYAN-0012	Collected:		10/8/2020	Lab ID:		062018953-0006
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	10/12/2020	DI	10/14/2020	AL
Client Sample Description		WYAN-0013	Collected:		10/8/2020	Lab ID:		062018953-0007
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	10	3.0	µg/L	10/12/2020	DI	10/14/2020	AL
Client Sample Description		WYAN-0014	Collected:		10/8/2020	Lab ID:		062018953-0008
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062018953

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Tara Ricker**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 10/8/2020 12:24 PM
 Collected: 10/8/2020

Project: #19-45375, Wyandanch Memorial High School, Wyandanch Union Free School District, 54 South 32nd Street, Wyandanch, NY 11798

Analytical Results

Client Sample Description WYAN-0014 **Collected:** 10/8/2020 **Lab ID:** 062018953-0008

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.8	3.0 µg/L	10/12/2020	DI	10/14/2020	AL

Client Sample Description WYAN-0015 **Collected:** 10/8/2020 **Lab ID:** 062018953-0009

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	9.6	3.0 µg/L	10/12/2020	DI	10/14/2020	AL

Client Sample Description WYAN-0016 **Collected:** 10/8/2020 **Lab ID:** 062018953-0010

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.2 J	3.0 µg/L	10/12/2020	DI	10/14/2020	AL

Lead MDL: 1.0µg/L

Client Sample Description WYAN-0017 **Collected:** 10/8/2020 **Lab ID:** 062018953-0011

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.4	3.0 µg/L	10/12/2020	DI	10/14/2020	AL

Client Sample Description WYAN-0018 **Collected:** 10/8/2020 **Lab ID:** 062018953-0012

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.0	3.0 µg/L	10/12/2020	DI	10/14/2020	AL

Client Sample Description WYAN-0019 **Collected:** 10/8/2020 **Lab ID:** 062018953-0013

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.0	3.0 µg/L	10/12/2020	DI	10/14/2020	AL

Client Sample Description WYAN-0020 **Collected:** 10/8/2020 **Lab ID:** 062018953-0014

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	10/12/2020	DI	10/14/2020	AL

Client Sample Description WYAN-0021 **Collected:** 10/8/2020 **Lab ID:** 062018953-0015

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062018953

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Tara Ricker**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 10/8/2020 12:24 PM
 Collected: 10/8/2020

Project: #19-45375, Wyandanch Memorial High School, Wyandanch Union Free School District, 54 South 32nd Street, Wyandanch, NY 11798

Analytical Results

Client Sample Description		WYAN-0021	Collected:		10/8/2020	Lab ID:		062018953-0015
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.0	3.0	µg/L	10/12/2020	DI	10/14/2020	AL
Client Sample Description		WYAN-0022	Collected:		10/8/2020	Lab ID:		062018953-0016
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.1	3.0	µg/L	10/12/2020	DI	10/14/2020	AL
Client Sample Description		WYAN-0023	Collected:		10/8/2020	Lab ID:		062018953-0017
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	13	3.0	µg/L	10/12/2020	DI	10/14/2020	AL
Client Sample Description		WYAN-0024	Collected:		10/8/2020	Lab ID:		062018953-0018
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	9.1	3.0	µg/L	10/12/2020	DI	10/14/2020	AL
Client Sample Description		WYAN-0034	Collected:		10/8/2020	Lab ID:		062018953-0019
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	10/12/2020	DI	10/14/2020	AL
Client Sample Description		WYAN-0035	Collected:		10/8/2020	Lab ID:		062018953-0020
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.3 J	3.0	µg/L	10/12/2020	DI	10/14/2020	AL
		Lead MDL: 1.0µg/L						
Client Sample Description		WYAN-0036	Collected:		10/8/2020	Lab ID:		062018953-0021
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	10/12/2020	DI	10/14/2020	AL
Client Sample Description		WYAN-0037	Collected:		10/8/2020	Lab ID:		062018953-0022
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062018953

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Tara Ricker**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 10/8/2020 12:24 PM
 Collected: 10/8/2020

Project: #19-45375, Wyandanch Memorial High School, Wyandanch Union Free School District, 54 South 32nd Street, Wyandanch, NY 11798

Analytical Results

Client Sample Description WYAN-0037 **Collected:** 10/8/2020 **Lab ID:** 062018953-0022

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	9.4	3.0 µg/L	10/12/2020	DI	10/14/2020	AL

Client Sample Description WYAN-0038 **Collected:** 10/8/2020 **Lab ID:** 062018953-0023

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.7 J	3.0 µg/L	10/12/2020	DI	10/14/2020	AL

Lead MDL: 1.0µg/L

Client Sample Description WYAN-0039 **Collected:** 10/8/2020 **Lab ID:** 062018953-0024

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	10/12/2020	DI	10/14/2020	AL

Client Sample Description WYAN-0040 **Collected:** 10/8/2020 **Lab ID:** 062018953-0025

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	10/12/2020	DI	10/14/2020	AL

Client Sample Description WYAN-0042 **Collected:** 10/8/2020 **Lab ID:** 062018953-0026

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	43	3.0 µg/L	10/12/2020	DI	10/14/2020	AL

Client Sample Description WYAN-0052 **Collected:** 10/8/2020 **Lab ID:** 062018953-0027

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	10/12/2020	DI	10/14/2020	AL

Client Sample Description WYAN-0063 **Collected:** 10/8/2020 **Lab ID:** 062018953-0028

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	10/12/2020	DI	10/14/2020	AL

Client Sample Description WYAN-0064 **Collected:** 10/8/2020 **Lab ID:** 062018953-0029

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062018953

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Tara Ricker**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 10/8/2020 12:24 PM
 Collected: 10/8/2020

Project: #19-45375, Wyandanch Memorial High School, Wyandanch Union Free School District, 54 South 32nd Street, Wyandanch, NY 11798

Analytical Results

Client Sample Description WYAN-0064 **Collected:** 10/8/2020 **Lab ID:** 062018953-0029

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.1	3.0 µg/L	10/12/2020	DI	10/14/2020	AL

Client Sample Description WYAN-0065 **Collected:** 10/8/2020 **Lab ID:** 062018953-0030

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.2 J	3.0 µg/L	10/12/2020	DI	10/14/2020	AL

Lead MDL: 1.0µg/L

Client Sample Description WYAN-0066 **Collected:** 10/8/2020 **Lab ID:** 062018953-0031

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.5	3.0 µg/L	10/12/2020	DI	10/14/2020	AL

Client Sample Description WYAN-0069 **Collected:** 10/8/2020 **Lab ID:** 062018953-0032

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	25	3.0 µg/L	10/12/2020	DI	10/14/2020	AL

Client Sample Description WYAN-0070 **Collected:** 10/8/2020 **Lab ID:** 062018953-0033

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	26	3.0 µg/L	10/12/2020	DI	10/14/2020	AL

Client Sample Description WYAN-0071 **Collected:** 10/8/2020 **Lab ID:** 062018953-0034

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	10/12/2020	DI	10/14/2020	AL

Client Sample Description WYAN-0073 **Collected:** 10/8/2020 **Lab ID:** 062018953-0035

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	10/12/2020	DI	10/14/2020	AL

Client Sample Description WYAN-0101 **Collected:** 10/8/2020 **Lab ID:** 062018953-0036

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062018953

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Tara Ricker**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 10/8/2020 12:24 PM
 Collected: 10/8/2020

Project: #19-45375, Wyandanch Memorial High School, Wyandanch Union Free School District, 54 South 32nd Street, Wyandanch, NY 11798

Analytical Results

Client Sample Description WYAN-0101 **Collected:** 10/8/2020 **Lab ID:** 062018953-0036

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	10/12/2020	DI	10/14/2020	AL

Client Sample Description WYAN-0126 **Collected:** 10/8/2020 **Lab ID:** 062018953-0037

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.4 J	3.0 µg/L	10/12/2020	DI	10/14/2020	AL

Lead MDL: 1.0µg/L

Client Sample Description WYAN-0136 **Collected:** 10/8/2020 **Lab ID:** 062018953-0038

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	10/12/2020	DI	10/14/2020	AL

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL.

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



062022835 Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45375

Building: Wyandanch Memorial High School

WMHS

Client:

Wyandanch Union Free School District

Retest/New Install ☐

Turn Around: Normal ☒ Rush ☐

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
WYAN-0003	BR	1020D1	Boys' Locker Room Coach's Office Bathroom	BF	12/9/2020	5:49:00 AM
WYAN-0011	BR	1025A1	Girls' Locker Room Coach's Office Bathroom	BF	12/9/2020	5:47:00 AM
WYAN-0042	OF	1054A	Central Registration/Attendance Office	KC	12/9/2020	5:54:00 AM
WYAN-0069	FL	1069	Faculty Room 103	KC	12/9/2020	5:51:00 AM
WYAN-0070	FL	1069	Faculty Room 103	SN	12/9/2020	5:50:00 AM

Samples Submitted 5

20 DEC - 9 PM 3:44
ANALYTICAL, INC.
CANE PLACE, NY
b

PO 200.5
12/11/2020

Building Address

54 South 32nd Street

Wyandanch, NY 11798

Analysis Type: ELAP 200.5

Lab Received: Unique mark

Signature: um 12/9/20 @ 3:44 PM

Samplers Name: Alexandria Orlassino

Samplers Signature: A Orlassino

JCB Project Manager: Tara Ricker



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

**Tara Ricker
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788**

12/21/2020

Phone: (631) 584-5492

Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 12/9/2020. The results are tabulated on the attached data pages for the following client designated project:

**Wyandanch Memorial High School, 54 South 32nd Street,
Wyandanch, NY 11798, Wyandanch Union Free School District,
10-15375**

The reference number for these samples is EMSL Order #062022835. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Alger Liang, Lead Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062022835

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Tara Ricker**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 12/9/2020 03:44 PM
 Collected: 12/9/2020

Project: **Wyandanch Memorial High School, 54 South 32nd Street, Wyandanch, NY 11798, Wyandanch Union Free School District, 19-45375**

Analytical Results

Client Sample Description		WYAN-0003	Collected:	12/9/2020 5:49:00 AM	Lab ID:	062022835-0001		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	20	3.0	µg/L	12/10/2020	AM	12/11/2020	DI
Client Sample Description		WYAN-0011	Collected:	12/9/2020 5:49:00 AM	Lab ID:	062022835-0002		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	52	3.0	µg/L	12/10/2020	AM	12/11/2020	DI
Client Sample Description		WYAN-0042	Collected:	12/9/2020 5:49:00 AM	Lab ID:	062022835-0003		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	220	3.0	µg/L	12/10/2020	AM	12/11/2020	DI
Client Sample Description		WYAN-0069	Collected:	12/9/2020 5:49:00 AM	Lab ID:	062022835-0004		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	140	3.0	µg/L	12/10/2020	AM	12/11/2020	DI
Client Sample Description		WYAN-0070	Collected:	12/9/2020 5:49:00 AM	Lab ID:	062022835-0005		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	75	3.0	µg/L	12/10/2020	AM	12/11/2020	DI

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL.

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted

Attachment 3:

Laboratory Certifications


J.C. Broderick & Associates, Inc.

Environmental Consulting & Testing

1775 Expressway Drive North

Hauppauge, New York 11788

631.584.5492 fax 631.584.3395

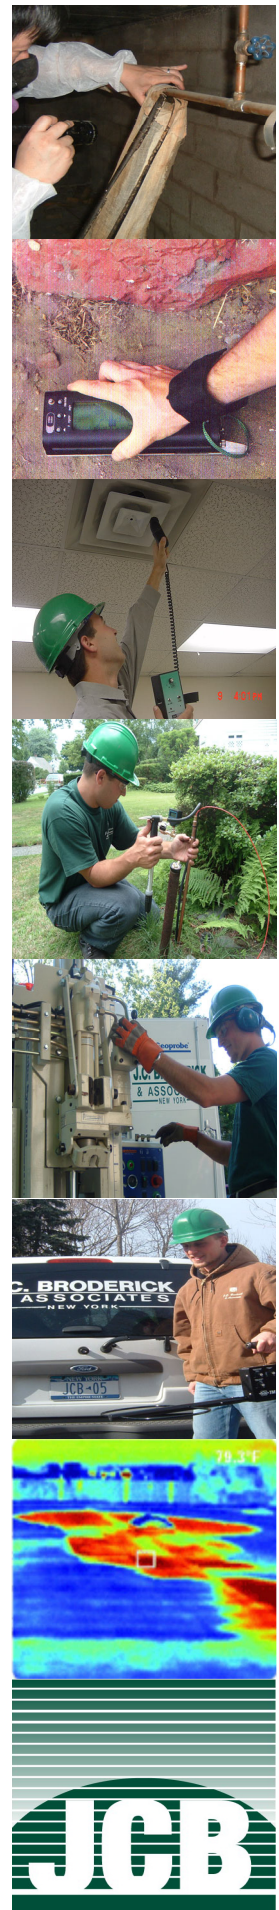

NEW YORK STATE DEPARTMENT OF HEALTH
WADSWORTH CENTER



Expires 12:01 AM April 01, 2021
Issued April 01, 2020

CERTIFICATE OF APPROVAL FOR LABORATORY SERVICE

Issued in accordance with and pursuant to section 502 Public Health Law of New York State

MR. DANIEL CLARKE
EMSL ANALYTICAL, INC.
528 MINEOLA AVE.
CARLE PLACE, NY 11514

NY Lab Id No: 11469

*is hereby APPROVED as an Environmental Laboratory in conformance with the
National Environmental Laboratory Accreditation Conference Standards (2003) for the category
ENVIRONMENTAL ANALYSES POTABLE WATER
All approved analytes are listed below:*

Bacteriology

Coliform, Total / E. coli (Qualitative)	SM 21, 23 9222A,B,C SM 20, 21-23 9223B (-04) (Colilert)
E. coli (Enumeration)	SM 21, 23 9222A,B,C
Enterococci	SM 20, 23 9230C (Budnick 1996)
Heterotrophic Plate Count	SimPlate SM 20, 21-23 9215B (-04)

Metals I

Lead, Total	EPA 200.5
-------------	-----------

Miscellaneous

Asbestos	EPA 100.2
----------	-----------

Serial No.: 61397

Property of the New York State Department of Health. Certificates are valid only at the address shown, must be conspicuously posted, and are printed on secure paper. Continued accreditation depends on successful ongoing participation in the Program. Consumers are urged to call (518) 485-5570 to verify the laboratory's accreditation status.

